

SIEMENS

Power Monitoring Device and Power Quality Recorder

SENTRON PAC5100/5200
7KM5212/5412

V1.00

Communication Manual

Preface

Open Source Software

Contents

Communication

1

Glossary

Index

E50417-C1040-C568-A1



NOTE

For your own safety, please observe the warnings and safety instructions contained in this document.

Disclaimer of Liability

This document has been subjected to rigorous technical review before being published. It is revised at regular intervals, and any modifications and amendments are included in the subsequent issues. The content of this document has been compiled for information purposes only. Although Siemens AG has made best efforts to keep the document as precise and up-to-date as possible, Siemens AG shall not assume any liability for defects and damage which result through use of the information contained herein.

This content does not form part of a contract or of business relations; nor does it change these. All obligations of Siemens AG are stated in the relevant contractual agreements.

Siemens AG reserves the right to revise this document from time to time.

Document version: E50417-C1040-C568-A1.00
Edition 03.2015
Product version: V1.00

Copyright

Copyright © Siemens AG 2015. All rights reserved.
The disclosure, duplication, distribution and editing of this document, or utilization and communication of the content are not permitted, unless authorized in writing. All rights, including rights created by patent grant or registration of a utility model or a design, are reserved.

Registered Trademarks

SENTRON® is a registered trademark of SIEMENS AG. An unauthorized use is illegal.

All other designations in this document can be trademarks whose use by third parties for their own purposes can infringe the rights of the owner.

Preface

Purpose of this Manual

This manual describes the communication of the Power Monitoring Device and Power Quality Recorder SENTRON PAC5100/5200.

Target Group

This manual is intended for project engineers, commissioning and operating personnel in electrical systems and power plants.

Scope of Validity of this Manual

This manual is valid for the Power Monitoring Device and Power Quality Recorder SENTRON PAC5100/5200.

Further Support

For any questions concerning your system, please contact your Siemens representative.

Siemens provides around-the-clock support.

Phone: +49 (911) 895-7222

Fax: +49 (911) 895-7223

Internet: <http://www.siemens.com/automation/service&support>

Training Courses

If you are interested in our current training program, please contact our training center:

Siemens AG

Siemens Power Academy TD

Humboldtstr. 59

D-90459 Nuremberg

Tel.: +49 (911) 433-7415

Fax: +49 (911) 433-7929

Internet: <http://www.siemens.com/poweracademy>

e-mail: poweracademy@siemens.com

Notes On Safety

This manual does not constitute a complete catalog of all safety measures required for operating the equipment (module, device) in question, because special operating conditions may require additional measures. However, it does contain notes that must be adhered to for your own personal safety and to avoid damage to property. These notes are highlighted with a warning triangle and different keywords indicating different degrees of danger.



DANGER

DANGER means that death or severe injury **will** occur if the appropriate safety measures are not taken.

- ✧ Follow all advice instructions to prevent death or severe injury.
-



WARNING

WARNING means that death or severe injury **can** occur if the appropriate safety measures are not taken.

- ✧ Follow all advice instructions to prevent death or severe injury.
-



CAUTION

CAUTION means that minor or moderate injury can occur if the appropriate safety measures are not taken.

- ✧ Follow all advice instructions to prevent minor injury.
-

NOTICE

NOTICE means that damage to property can occur if the appropriate safety measures are not taken.

- ✧ Follow all advice instructions to prevent damage to property.
-



NOTE

is important information about the product, the handling of the product, or the part of the documentation in question to which special attention must be paid.

Personnel Qualified in Electrical Engineering

Commissioning and operation of the equipment (module, device) described in this manual must be performed by personnel qualified in electrical engineering only. As used in the safety notes contained in this manual, electrically qualified personnel are those persons who are authorized to commission, release, ground and tag devices, systems, and electrical circuits in accordance with safety standards.

Use as Prescribed

The equipment (device, module) must not be used for any other purposes than those described in the Catalog and the Technical Description. If it is used together with third-party devices and components, these must be recommended or approved by Siemens.

If the device is not used in accordance with the operating instruction and this manual, the scheduled protection is impaired.









Problem-free and safe operation of the product depends on the following:

- Proper transport
- Proper storage, setup, and installation
- Proper operation and maintenance


When electrical equipment is operated, hazardous voltages are inevitably present in certain parts. If proper action is not taken, death, severe injury, or property damage can result.

- The equipment must be grounded at the grounding terminal before any connections are made.
- All circuit components connected to the power supply may be subject to dangerous voltage.
- Hazardous voltages may be present in equipment even after the supply voltage has been disconnected (capacitors can still be charged).
- Equipment with exposed current transformer circuits must not be operated. Prior to disconnecting the equipment, ensure that the current transformer circuits are short-circuited.
- The limit values stated in the document may not be exceeded. This must also be considered during testing and commissioning.


Used Symbols

No.	Symbol	Description
1		Direct current IEC 60417-5031
2		Alternating current IEC 60417-5032
3		Direct and alternating current IEC 60417-5033
4		3-phase alternating current
5		Earth (ground) terminal IEC 60417-5017
6		Protective conductor terminal IEC 60417-5019
7		Caution, risk of electric shock
8		Caution, risk of danger ISO 7000-0434

Statement of Conformity

	<p>This product complies with the directive of the Council of the European Communities on the approximation of the laws of the Member States relating to electromagnetic compatibility (EMC Council Directive 2004/108/EC) and concerning electrical equipment for use within specified voltage limits (Low-voltage Directive 2006/95/EC).</p> <p>This conformity has been established by means of tests conducted by Siemens AG according to the Council Directive in agreement with the generic standards EN 61000-6-2 and EN 61000-6-4 for the EMC directives, and with the standard EN 61010-1 for the low-voltage directive.</p> <p>The device has been designed and produced for industrial use.</p> <p>The product conforms to the standard IEC 61557-12.</p>
---	--

Further Standards

<p>This product is UL-certified to Standard UL 61010-1, third edition, based on the specification stated in chapter 12 (Technical Data) of Device Manual. UL File No.: E228586</p>	
	<p>Open-type Measuring Equipment 2UD1</p>

For further information see UL database on the internet: <http://ul.com>.

Chose **Online Certifications Directory** and insert E228586 under **UL File Number**.

Open Source Software

The product contains, among other things, Open Source Software developed by third parties. The Open Source Software used in the product and the license agreements concerning this software can be found in the Readme_OSS.

These Open Source Software files are protected by copyright. Your compliance with those license conditions will entitle you to use the Open Source Software as foreseen in the relevant license. In the event of conflicts between Siemens license conditions and the Open Source Software license conditions, the Open Source Software conditions shall prevail with respect to the Open Source Software portions of the software.

The Open Source Software is licensed royalty-free. Insofar as the applicable Open Source Software License Conditions provide for it you can order the source code of the Open Source Software from your Siemens sales contact - against payment of the shipping and handling charges - for a period of at least 3 years since purchase of the Product. We are liable for the Product including the Open Source Software contained in it pursuant to the license conditions applicable to the Product. Any liability for the Open Source Software beyond the program flow intended for the Product is explicitly excluded. Furthermore any liability for defects resulting from modifications to the Open Source Software by you or third parties is excluded. We do not provide any technical support for the Product if it has been modified.

Contents

- Preface** **3**
- Open Source Software** **9**
- 1 Communication** **13**
 - 1.1 Communication via Ethernet 14
 - 1.1.1 TCP/IP Protocol Stack 14
 - 1.1.2 IP Address 14
 - 1.1.3 Ethernet Interface 17
 - 1.2 Modbus 18
 - 1.2.1 Modbus Functions for Modbus TCP Server 18
 - 1.2.2 Exception Responses for Modbus TCP Server 19
 - 1.2.3 Modbus TCP Server 20
 - 1.2.4 Register Assignment 21
 - 1.2.5 Data Types 21
 - 1.2.6 Data in the Modbus Registers (Data Mapping) 26
 - 1.2.7 Modbus TCP Diagnosis 92
- Glossary** **95**
- Index** **99**

1 Communication

1.1	Communication via Ethernet	14
1.2	Modbus	18

1.1 Communication via Ethernet

Via the Ethernet interface the following functions are supported:

- Parameterization, analysis and diagnosis with HTML pages
- DHCP (Dynamic Host Configuration Protocol) to assign the network configuration (IP address etc.) to clients in an Ethernet network with DHCP server
- Time synchronization via NTP
- Data transfer to connected devices via Modbus TCP



NOTE

Siemens recommends not to use SENTRON PAC5100/5200 in Ethernet systems with high utilization without a connected external Ethernet switch. Since none of the devices is equipped with an internal Ethernet switch, high network utilization might result in overloading of the data traffic in the device and thus in malfunctions, even if the data traffic is intended for other devices in the network.

1.1.1 TCP/IP Protocol Stack

SETRON PAC5100/5200 supports the following TCP/IP services:

- TCP/IP IPv4
- DHCP client (Dynamic Host Configuration Protocol)
- NTP (Network Time Protocol)
- HTTP server

1.1.2 IP Address

To enable the device to communicate within the Ethernet network, you have to establish a network configuration consisting of IP address, subnet mask and standard gateway.

The device is delivered with a default IP address that can be restored at any time by pressing the F4 softkey. Each device also has a unique MAC address.

The default IP address and the default subnet mask are imprinted on the side panel, see Figure 1-1:

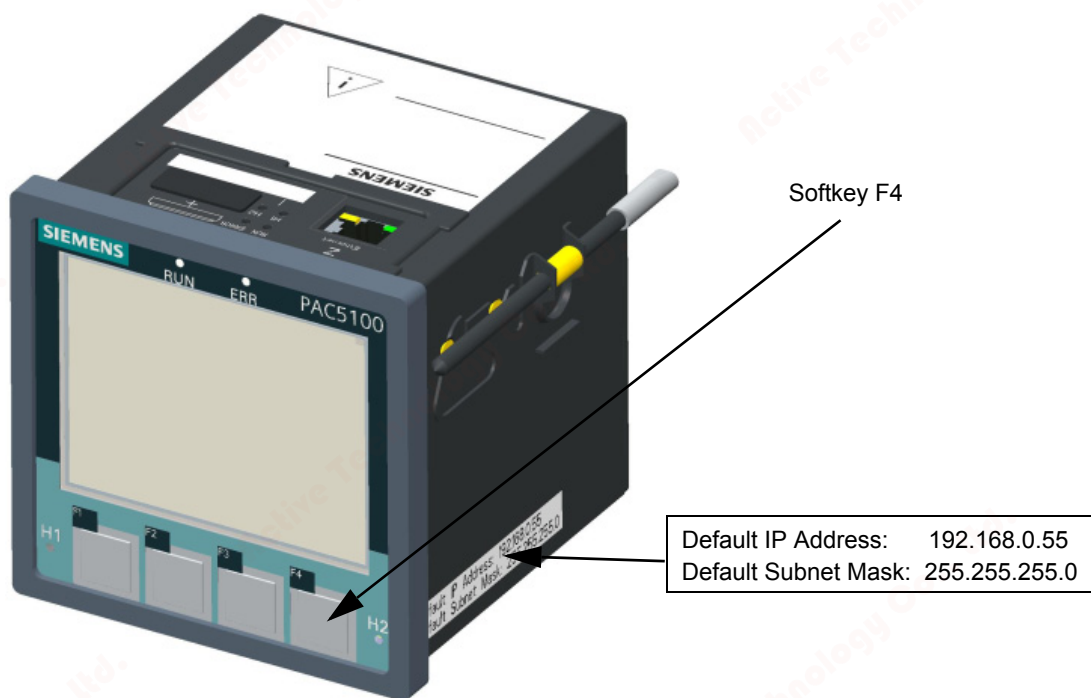


Figure 1-1 Display Side with Softkey F4

Default IP Address and Softkey F4

The F4 softkey (see Figure 1-1) located on the right display side can be used to activate the factory-set default IP address. When pressed (>3 s), this softkey activates the factory-set default IP address. After pressing the softkey F4, the device restarts and the IP address and subnet mask are temporarily activated in the default IP network configuration. The customer-specific IP configuration is not overwritten.

The network configuration settings can be displayed and edited via HTML pages or via the device display (see Device Manual SENTRON PAC5100/5200). After a renewed restart the parameterized network configuration is used again.

Check for Twice Assigned IP Address

Serious problems can occur if the same IP address is assigned more than once in a communication network.

For this reason, an ARP request is sent to the own IP address during start-up of the device. If no response is received from the communication network within 2 s, it is assumed that the IP address is not used in the network.

Otherwise, the LEDs (see Device Manual SENTRON PAC5100/5200, chapter 12) signal that the IP address is already assigned and the device is not connected to the network. In this case, you have to specify a different IP address.



NOTE

If the device is directly connected to a PC (without Ethernet switch), the PC will need a longer period to be able to detect the connection and therefore to receive the ARP telegram. In this case it may not be detected when PC and device have the same IP address.

Reception of the Network Configuration from the DHCP Server

The network configuration can also be obtained from an external server. Using the DHCP protocol, the device is integrated into an already existing network.

If the IP address 0.0.0.0 is configured, the device sends a query to the external DHCP server requesting the network configuration immediately after booting. Having received the network configuration, the device launches the Ethernet services.

If no DHCP server is available, disconnect the device from the network and start it using the default IP address and subsequently assign a permanent IP address.

1.1.3 Ethernet Interface

SETRON PAC5100/5200 is equipped with an Ethernet interface. The data are exchanged via the RJ45 Ethernet plug connector located on the top side of the device.

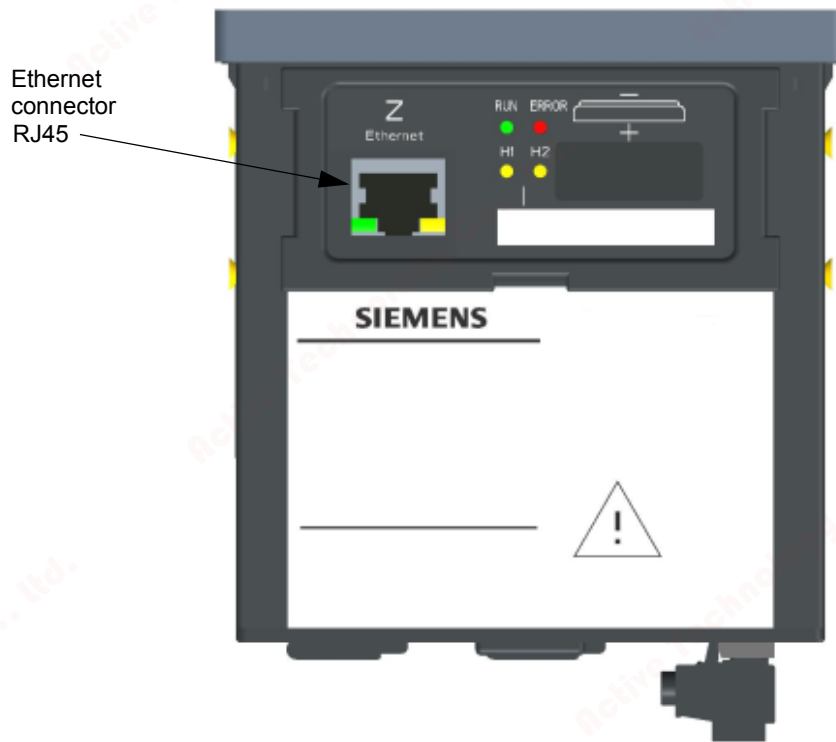


Figure 1-2 RJ45 Ethernet Plug Connector

The Ethernet interface is characterized by the following parameters:

- Transmission rate: 10/100 Mbit/s
- Protocol: IEEE802.3
- Connection: 100Base-T (RJ45), pinout according to DIN EN 50173, automatic patch/crossover cable recognition
- Connecting cable: 100 Ω to 150 Ω STP, CAT5 (shielded twisted-pair cable), max. 100 m if well installed

1.2 Modbus

When communicating via Ethernet, the Modbus TCP protocol is used. The Modbus specification with a detailed explanation of the Modbus protocol is provided in:

- Modbus over Serial Line
Specification & Implementation Guide
<http://www.modbus.org>
- Modbus Application Protocol Specification
<http://www.modbus.org>
- Modbus Messaging on TCP/IP Implementation Guide
<http://www.modbus.org>

1.2.1 Modbus Functions for Modbus TCP Server

The Modbus TCP server of SENTRON PAC5100/5200 supports the following Modbus functions:

Table 1-1 Supported Modbus Functions

Function Number	Function Name	Description
03 (03H)	Read Holding Registers	Reading one or more holding registers from the Modbus server Up to 125 registers can be read with one message.
06 (06H)	Write Single Register	Writing a holding register Function 16 is used for writing multiple holding register using one Modbus message.
16 (10H)	Write Multiple Registers	Writing one or more holding registers Up to 123 registers can be written with one message.

1.2.2 Exception Responses for Modbus TCP Server

The Modbus TCP server performs a series of consistency checks of the Modbus client requests, and if errors (for example request to read a nonexistent register) are detected, it generates Modbus exception codes which are signaled to the Modbus client in exception responses messages.

The messages contain the following codes:

Exception Code 01 **ILLEGAL_FUNCTION**

- The Modbus client uses a function that is not supported by the Modbus TCP server of the SENTRON PAC5100/5200. The supported Modbus functions are listed in chapter 1.2.1.

Exception Code 02 **ILLEGAL_DATA_ADDRESS**

- An attempt is made to read out or write to a nonexistent Modbus register (see chapter 1.2.6, Modbus mapping for valid registers).
- An attempt is made to read out or write to too many registers. A Modbus message enables reading out 125 holding registers and writing to 123 holding registers maximum.
- The Modbus client tries to write to a register in the Modbus server for which only read access is allowed according to the Modbus mapping (see chapter 1.2.6).

Exception Code 03 **ILLEGAL_DATA_VALUE**

- The redundancy client addresses a register that does not allow access to partial data. The register has a complex data structure and is distributed across several registers. The register can be read or written only as a whole.
- The Modbus client tries to write to the Modbus TCP server for which the access rights are set to "read only".

Exception Code 04 **SERVER_FAILURE**

- Error during the time format conversion in the Modbus TCPserver because a faulty date/time format was received via Modbus, for example month format > 12.

1.2.3 Modbus TCP Server

Properties of the Modbus TCP Server

- Connection-oriented Ethernet protocol based on TCP/IP
- Use of IP addresses for addressing individual components connected to the bus (bus nodes)
- The Modbus TCP protocol has the TCP port number 502 reserved on the server side. It is possible to use a parameterized port number.
- All data types in the Modbus TCP messages which are larger than 1 byte are stored in the big-endian format, that is the most significant byte (MSB) is stored at the lowest register address and is transmitted first.
- Communication sequence:
 - The client sends a request to the server to start a data transmission from the server to the client.
 - If the requested data are not available, the server sends an error feedback to the client.
- The Modbus TCP data packet has a maximum size of 260 bytes:
 - 253 bytes max. for data and
 - 7 bytes for the Modbus TCP header

Parameterization

The following parameters can be set for the Modbus TCP bus protocol (see also Device Manual SENTRON PAC5100/5200, chapter 8):

Table 1-2 Modbus TCP Settings

Parameter	Default Setting	Settings
IP address	192.168.0.55	any, 0.0.0.0 for DHCP
Subnet mask	255.255.255.0	any
Default gateway	192.168.0.1	any
Enable SNMP	no	no yes
Bus protocol	Modbus TCP	-
Use a user-port number	no	no yes
User-port number (only if <i>Use a user-port number</i> yes has been parameterized)	10000	10000 to 65535
Access rights for user port 502	Full	Full Read only
Access rights for user port (only if <i>Use a user-port number</i> yes has been parameterized)	Full	Full Read only
Keep Alive time	10 s	0 s = switch off 1 s to 65 535 s
Communication supervision time	600 * 100 ms	0 s = none 100 ms to 6 553 400 ms

Number of Connections

Up to four TCP connections are possible:

- Without user port number: 4 connections via standard port 502
- With user port number: 2 connections via standard port 502 and 2 connections via the user port

1.2.4 Register Assignment

Only holding registers are used for SENTRON PAC5100/5200. All measured values, indications, metered values etc. are stored in these holding registers.

1.2.5 Data Types

The following data types are used for storing variables in the Modbus registers.

- Measured value
- Date/time
- Indication
- Controllable indications
- Counter



NOTE

The following convention applies when storing variables consisting of more complex data types to the Modbus holding register (that is variables which are larger than a holding register, for example 32-bit measured values):


The register with the lowest address contains the most significant byte (MSB), the register with the highest address contains the least significant byte (LSB).

1.2.5.1 Data Type - Measured Value

The *Measured Value* data type is transferred into 2 holding registers in 32-bit floating-point format (single precision) according to IEEE standard 754.

Structure of the Format

The 32-bit floating-point format consists of a sign bit (S), exponent and mantissa:

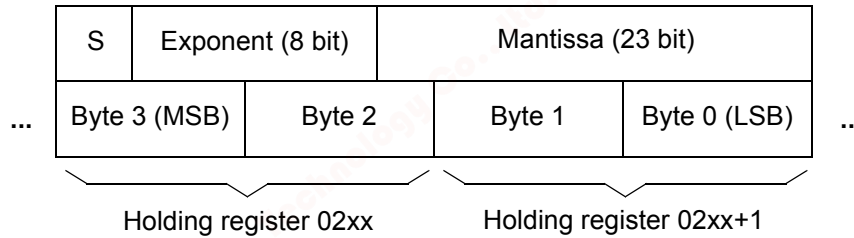

Value Range

The 32-bit floating-point format has the value range: $\pm(10^{-38}$ to 10^{+38}).

Value of the Measured Values

The value of a measured value is obtained as follows:

Exponent = 0: Resulting value = 0

Exponent = 255, mantissa = 0: Resulting value = $(-1)^{\langle \text{sign} \rangle} * +\text{Inf}$

Exponent = 255, mantissa not equal to 0: Resulting value = NaN

$0 < \text{Exponent} < 255$: Resulting value = $(-1)^{\langle \text{sign} \rangle} * 2^{(\langle \text{exponent} \rangle - 127)} * 1, \langle \text{mantissa} \rangle$

Status and Quality Information

SENTRON PAC5100/5200 uses floating-point numbers with the exponent 255 (Inf, NaN) to display status information of the measured values:

Table 1-3 Floating-point Numbers

Floating-point Number (Hexadecimal)		State	Remark
7F800000H	+Inf	Overflow	Measured value overflow ($> 1.2 V_{\text{rated}}, > 2 I_{\text{rated}}$)
7F800001H	NaN	invalid	For example, frequency not measured because mains voltage too small ($< 15 \% V_{\text{rated}}$)
7F800002H	NaN	not calculated	Measured value is not calculated, for instance because it does not exist in the selected network type.

Accuracy of the Floating-point Numbers


The 32-bit floating-point numbers have a 23-bit mantissa. Integer numbers can be represented in the following ranges without loss of accuracy:

- Binary: $\pm(1)111\ 1111\ 1111\ 1111\ 1111\ 1111$
- Hexadecimal: $\pm FF\ FF\ FF$
- Decimal: ± 16777216

32-bit floating-point numbers are accurate to about 7 decimal digits. An accuracy of 4 decimal digits (0.2 measuring error) is required for measuring alternating current quantities.

1.2.5.2 Data Type - Date/Time

The *Date/Time* data type is used to transmit the local time. The following format is used:

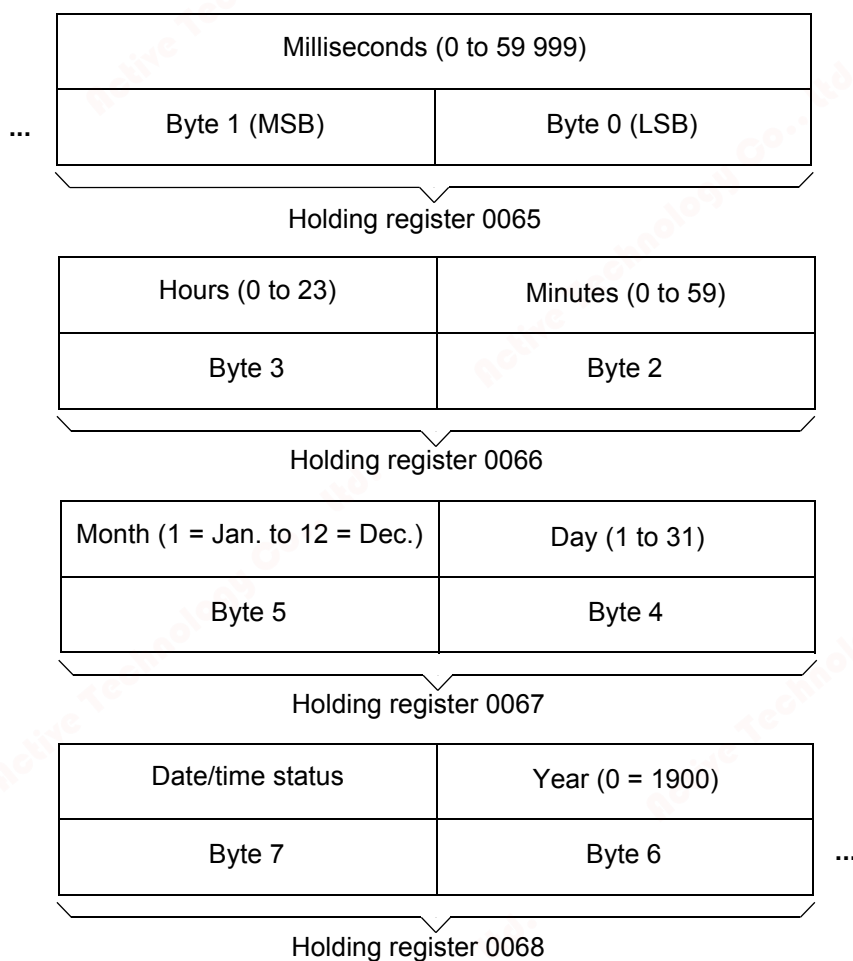

Date/Time Status

10H set: Daylight saving time active

20H set: Date/time error: equivalent to FAIL bit, see Device Manual SENTRON PAC5100/5200, Time Synchronization.



NOTE

For the time synchronization via Ethernet, Siemens recommends the use of NTP.

1.2.5.3 Data Type - Indications (Read Only)

The *Indications* data type is represented by two bits in holding registers:

Q	V	Q	V	Q	V	Q	V	Q	V	Q	V	Q	V	Q	V
Indication 8		Indication 7		Indication 6		Indication 5		Indication 4		Indication 3		Indication 2		Indication 1	

for example Holding register 0101

Where:

- Q: status/quality bit: 0 = OK, 1 = invalid
- V: Value bit: 0 = OFF, 1 = ON

Status or Quality Bit Q

An indication is invalid if the result of a calculation is based on an invalid measured value, for example the calculated limiting value of an invalid measured value. If the indication is invalid, the quality bit is set to 1. The value bit can be ignored in this case.

Example: The power frequency is invalid if the voltage is smaller than 15 % of the rated voltage when measuring the frequency. Any limit violation indication based on this value is also invalid.

For indications that are always valid, for example the internal device indication *Device OK*, 0 is transmitted as the quality bit.

Value Bit V

The value bit indicates whether an indication is ON (=1) or OFF (=0).

1.2.5.4 Data Type - Controllable Indications (Read/Write)

The *Controllable Indications* data type is needed for:

- The binary outputs of the SENTRON PAC5100/5200
- Processing internal device commands (for example resetting the energy counters).

The holding register is used for read and write access in this context.

Use as Read Register

Q	V	Q	V	Q	V	Q	V	Q	V	Q	V	Q	V	Q	V
Indication 8		Indication 7		Indication 6		Indication 5		Indication 4		Indication 3		Indication 2		Indication 1	


Holding register 0141

Where:

- Q: status/quality bit: 0 = OK, 1 = invalid
- V: Value bit: 0 = OFF, 1 = ON

See also chapter 1.2.5.3.

Use as Write Register

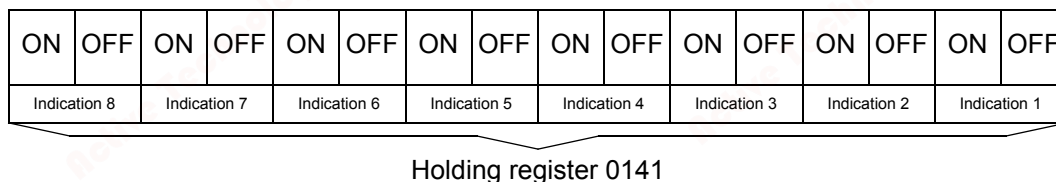

This data format enables up to 8 commands to be transmitted via the holding register for which the ON/OFF bits are set to either 0/1 or to 1/0. If these bits are set to 0/0 or 1/1, no evaluation will be performed.

1.2.5.5 Data Type - Counter

General

With the *Counter* data type, units of energy are transmitted as counter pulses.

To calculate the primary value, the conversion factor 'Energy per counter pulse' is output as the **Measured Value** data type in addition to the counter pulses (see chapter 1.2.5.1). The primary value is calculated as follows:


$$\text{Primary value} = \text{number of counter pulses} * \text{energy per counter pulse}$$

The following information is sent to each counter using the Modbus protocol:

- Counter pulses as 32-bit values (with sign)
- Separate status indications for **invalid** and **overflow** for each counter
- Energy per counter pulse in floating-point format for measured values (see chapter 1.2.6.16)

Counter Pulses

32-bit integers with sign allow a maximum of $\pm 2\,147\,483\,647$ counter pulses before the counter overflows. The *Counter* data type is structured as follows:

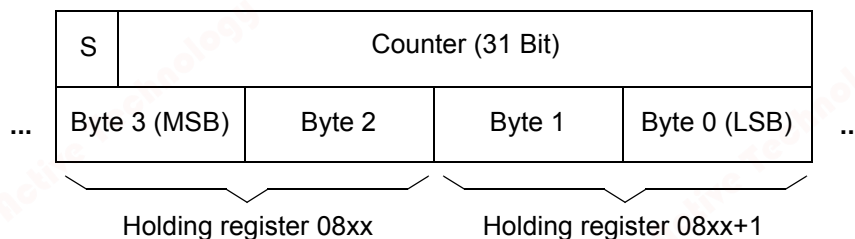


Bit S (Sign)

Reserved for negative metered values

Quality Information

The two following quality bits are stored for each counter in separate holding registers:

- **Overflow OV:** The internal counter pulse exceeds 31 bits. The Overflow bit is reset once the counter has been reset.
- **Invalid IV:** The counter value is invalid due to a reset/device start. The bit is deleted 1 min after the device start.

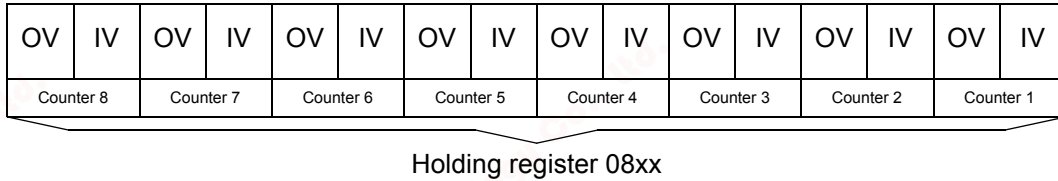

Energy per Counter Pulse

The energy per counter pulse is identical for all energy metered values calculated from the measured AC quantities so that only one value is transmitted for all energy counters. The energy per counter pulse is determined by the AC network configuration.

At the rated value 60 000 counter pulses per hour are recorded for V_{rated} and I_{rated} .

A counter overflow occurs about 4 years after the counters were reset when V_{rated} and I_{rated} are measured continuously.

1.2.6 Data in the Modbus Registers (Data Mapping)

The indications, measured values etc. are stored in Holding registers. The following register groups exist. They are described in the following sections:

- Register 0001 to 0048: Device identification (read only)
- Register 0065 to 0068: Date and time (read and write)
- Register 0071 to 0088: Version information (read only)
- Register 0101/0102: Device status (read only)
- Register 0111/0112: Indications concerning limit violations (read only)
- Register 0113: Group indications (read only)
- Register 0114: PQ events (read only)
- Register 0131: Status of the binary outputs (read only)
- Register 0141: Messages of the communication (read and write)
- Register 0201 to 0322: Measured values (read only), without 0281 to 0292
- Register 0323 to 0358: Flicker (read only)
- Register 0392 to 0395: Date/Time for last period PQ calculation for frequency (fixed period = 10 s) (read only)
- Register 0396 to 0399: Date/Time for last period PQ calculation (configurable) (read only)
- Register 0401 to 0760: PQ Measured (read only)
- Register 0801 to 0846: Energy counters (read only)
- Register 1001 to 1280: Harmonics: voltage values (read only)
- Register 1401 to 1680: Harmonics: current values (read only)
- Register 1801 to 2080: PQ calculation for average harmonic voltage values (read only)
- Register 2201 to 2480: PQ calculation for max. harmonic voltage values (read only)
- Register 2601 to 2880: PQ calculation for average harmonic current values (read only)

- Register 3001 to 3280: PQ calculation for max. harmonic current values (read only)
- Register 5001 to 5099: Last 10 dips (read only)
- Register 5201 to 5299: Last 10 swells (read only)
- Register 5401 to 5499: Last 10 interrupts (read only)
- Register 6001 to 6002: Total number of PQ events (read only)
- Register 6003 to 6004: Number of PQ events since last polling (read only)

1.2.6.1 Register 0001 to 0049: Device Identification

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Table 1-4 Register 0001 to 0049: Device Identification

Register	Type of Information	Remark
0001 to 0008	Device type (string, max. 16 characters)	Example: SENTRON_PAC
0009 to 0024	Device ordering code (string, max. 32 characters)	Example: 7KM54126BA001EA2
0025 to 0040	Device name from the configuration (string, max. 32 characters)	Example: SENTRON PAC #1
0041 to 0049	Device serial number (string, max. 16 characters)	Example: BF1401510270

1.2.6.2 Register 0065 to 0068: Date and Time

The date and time can be transmitted in 64-bit format or in 32-bit format.

64-bit Format

The 4 registers 0065 to 0068 (time and date) are transmitted in one message.

32-bit Format

The registers are transmitted in 2 messages. The 1st message contains the registers 0067 and 0068 (date), the 2nd message contains the registers 0065 and 0066 (time).

The time synchronization only takes effect when the time has been completely transmitted.

Data type: Date/time

Table 1-5 Register 0065 to 0068: Date and Time

Register	Type of Information	Remark
0065	Milliseconds	see chapter 1.2.5.2
0066	Hours/minutes	
0067	Month/day	
0068	Time status/year	

1.2.6.3 Register 0071 to 0089: Version Information

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Table 1-6 Register 0071 to 0089: Version Information

Register	Type of Information	Remark
0071 to 0076	Boot version	Example: V01.10.01
0077 to 0082	Firmware version	Example: V01.10.01
0083 to 0089	Parameter set version	Example: V01.10.01

1.2.6.4 Register 0101 to 0102: Device Status Indication

This register is write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: indication

Table 1-7 Register 0101 to 0102: Device Status

Register	Type of Information	Remark
0101/2 ⁰	Device OK	1 = Device ready for operation
0101/2 ²	Battery failure	0 = Battery OK, 1 = Battery failure (exchange battery)
0101/2 ⁴	SD card status	1 = SD card error (see notes in device manual, chapter 14, Operational Indications)
0101/2 ⁶	Reserved	= 0
0101/2 ⁸	Settings Load	1 = Parameter load is in progress

Table 1-7 Register 0101 to 0102: Device Status (cont.)

Register	Type of Information	Remark
0101/2 ¹⁰	Settings Check	1 = Parameter check is in progress
0101/2 ¹²	Settings Activate	1 = Parameter activation is in progress
0101/2 ¹⁴	Reserved	= 0
0102/2 ⁰	Direction of rotation	0 = Anti-clockwise 1 = Clockwise
0102/2 ² to 0102/2 ¹⁴	Reserved	= 0

**NOTE**

Registers between 0103 and 0141 that are not shown can be read too during requests and return the value 0.

1.2.6.5 Register 0111 and 0112: Measurand Limit Violation Indications

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: indication

Table 1-8 Register 0111 and 0112: Limit Violation Indications

Register	Type of Information	Remark
0111/2 ⁰	Limit Violation 1	An indication is output (= 1) if a measured value has exceeded or fallen below a configured limiting value. For more information, see the SENTRON PAC5100/5200 device manual, chapter Parameterization.
0111/2 ²	Limit Violation 2	
0111/2 ⁴	Limit Violation 3	
0111/2 ⁶	Limit Violation 4	
0111/2 ⁸	Limit Violation 5	
0111/2 ¹⁰	Limit Violation 6	
0111/2 ¹²	Limit Violation 7	
0111/2 ¹⁴	Limit Violation 8	

Table 1-8 Register 0111 and 0112: Limit Violation Indications (cont.)

Register	Type of Information	Remark
0112/2 ⁰	Limit Violation 9	An indication is output (= 1) if a measured value has exceeded or fallen below a configured limiting value. For more information, see the SENTRON PAC5100/5200 device manual, chapter Parameterization.
0112/2 ²	Limit Violation 10	
0112/2 ⁴	Limit Violation 11	
0112/2 ⁶	Limit Violation 12	
0112/2 ⁸	Limit Violation 13	
0112/2 ¹⁰	Limit Violation 14	
0112/2 ¹²	Limit Violation 15	
0112/2 ¹⁴	Limit Violation 16	

1.2.6.6 Register 0113: Group Indications

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: indication

Table 1-9 Register 0113: Group Indications

Register	Type of Information	Remark
0113/2 ⁰	Group indication 1	Up to 4 single-point indications can be linked logically and combined to a group indication. A total of 4 group indications can be parameterized: 0 = Off 1 = On
0113/2 ²	Group indication 2	
0113/2 ⁴	Group indication 3	
0113/2 ⁶	Group indication 4	
0113/2 ⁸	Reserved	= 0
0113/2 ¹⁰	Reserved	= 0
0113/2 ¹²	Reserved	= 0
0113/2 ¹⁴	Reserved	= 0

1.2.6.7 Register 0114: Power Quality Event

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: indication

Table 1-10 Register 0114: Power Quality Event

Register	Type of Information	Remark
0114/2 ⁰	PQ Volt event	1 = Voltage event exists 0 = Voltage event is not exists
0114/2 ²	PQ Freq event	1 = Frequency event exists 0 = Frequency event is not exists
0114/2 ⁴	PQ VoltUnbal event	1 = Voltage unbalance event exists 0 = Voltage unbalance event is not exists
0114/2 ⁶ to 0114/2 ¹⁴	Reserved	= 0

1.2.6.8 Register 0131: Status of the Binary Outputs

This register is write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: indication

Table 1-11 Register 0131: Status of the Binary Outputs

Register	Type of Information	Remark
0131/2 ⁰	Binary Output B1	Binary output B1 at terminal G1/3
0131/2 ²	Binary Output B2	Binary output B2 at terminal G1/2
0131/2 ⁴ to 0131/2 ¹⁴	Reserved	= 0

1.2.6.9 Register 0141: Indications of the Communication

Data type: controllable indications

Table 1-12 Register 0141: Indications of the Communication

Register	Type of Information	Remark
0141/2 ⁰	Indication 1 from Remote	Indications can be used for example for routing to a binary output
0141/2 ²	Indication 2 from Remote	
0141/2 ⁴ to 0141/2 ⁶	Reserved	= 0
0141/2 ⁸	Reset PQ Voltage Event	0 → 1: Resets PQ event
0141/2 ¹⁰	Reset PQ Frequency Event	0 → 1: Resets PQ event
0141/2 ¹²	Reset PQ VoltUnbal Event	0 → 1: Resets PQ event
0141/2 ¹⁴	Reset Energy	0 → 1: Resets the energy counters

1.2.6.10 Registers 0201 to 0322 (without 0281 to 0292): Measured Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: Measured value

Table 1-13 Registers 0201 to 0306: Measured Values

Register	Type of Information	Remark	Unit
0201	Va	Voltage a-N	V
0203	Vb	Voltage b-N	V
0205	Vc	Voltage c-N	V
0207	VN	Voltage neutral conductor	V
0209	Ia	Current a	A
0211	Ib	Current b	A
0213	Ic	Current c	A
0215	IN	Current neutral conductor	A
0217	Vab	Voltage a-b	V
0219	Vbc	Voltage b-c	V

Table 1-13 Registers 0201 to 0306: Measured Values (cont.)

Register	Type of Information	Remark	Unit
0221	Vca	Voltage c-a	V
0223	Vavg	Mean value of voltage (P-N)	V
0225	Iavg	Mean value of currents	A
0227	Pa	Active power a	W
0229	Pb	Active power b	W
0231	Pc	Active power c	W
0233	P	Active power	W
0235	Qa	Reactive power a	var
0237	Qb	Reactive power b	var
0239	Qc	Reactive power c	var
0241	Q	Reactive power	var
0243	Sa	Apparent power a	VA
0245	Sb	Apparent power b	VA
0247	Sc	Apparent power c	VA
0249	S	Apparent power	VA
0251	$\cos \varphi$ (a)	Active power factor a	-
0253	$\cos \varphi$ (b)	Active power factor b	-
0255	$\cos \varphi$ (c)	Active power factor c	-
0257	$\cos \varphi$	Active power factor	-
0259	PFa	Power factor a	-
0261	PFb	Power factor b	-
0263	PFc	Power factor c	-
0265	PF	Power factor	-
0267	φ a	Phase angle a	° (degree)
0269	φ b	Phase angle b	° (degree)
0271	φ c	Phase angle c	° (degree)

Table 1-13 Registers 0201 to 0306: Measured Values (cont.)

Register	Type of Information	Remark	Unit
0273	φ	Phase angle	° (degree)
0275	f	Power frequency	Hz
0277	U_2	Unbalanced voltage	%
0279	Iunbal	Unbalanced current	%
0281 to 0291	-	-	-
0293	f (10 s)	Frequency calculated every 10 s (internal)	Hz
0295	THDS (Va/Vab)	Voltage a/ab THDS	-
0297	THDS (Vb/Vbc)	Voltage b/bc THDS	-
0299	THDS (Vc/Vca)	Voltage c/ca THDS	-
0301	THDS (Ia)	Current a THDS	-
0303	THDS (Ib)	Current b THDS	-
0305	THDS (Ic)	Current c THDS	-
0307	Voltage (φ_{12})	Angle Vab-Vbc	° (degree)
0309	Voltage (φ_{13})	Angle Vab-Vca	° (degree)
0311	Current (φ_{12})	Angle Ia-Ib	° (degree)
0313	Current (φ_{13})	Angle Ia-Ic	° (degree)
0315	Q1a	Reactive power (A)_Fundamental	var
0317	Q1b	Reactive power (B)_Fundamental	var
0319	Q1c	Reactive power (C)_Fundamental	var
0321	Q1	Reactive power (Σ)_Fundamental	var

1.2.6.11 Registers 0323 to 0358: Flicker

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Registers 0323 to 0358: Flicker

Data type: Measured value

Table 1-14 Registers 0323 to 0358: Flicker

Register	Type of Information	Remark
0323	Pinst (a-N)	Flicker instantaneous value voltage Va
0325	Pinst (b-N)	Flicker instantaneous value voltage Vb
0327	Pinst (c-N)	Flicker instantaneous value voltage Vc
0329	Pst (a-N)	Short term flicker voltage Va
0331	Pst (b-N)	Short term flicker voltage Vb
0333	Pst (c-N)	Short term flicker voltage Vc
0335	Plt (a-N)	Long term flicker voltage Va
0337	Plt (b-N)	Long term flicker voltage Vb
0339	Plt (c-N)	Long term flicker voltage Vc
0341	Pinst (a-b)	Flicker instantaneous value voltage Va-b
0343	Pinst (b-c)	Flicker instantaneous value voltage Vb-c
0345	Pinst (c-a)	Flicker instantaneous value voltage Vc-a
0347	Pst (a-b)	Short term flicker voltage Va-b
0349	Pst (b-c)	Short term flicker voltage Vb-c
0351	Pst (c-a)	Short term flicker voltage Vc-a
0353	Plt (a-b)	Long term flicker voltage Va-b
0355	Plt (b-c)	Long term flicker voltage Vb-c
0357	Plt (c-a)	Long term flicker voltage Vc-a



NOTE

It depends on the connection type (ph-ph or ph-n) which measured values are available. Phase-to-phase quantities are available in 3-wire networks; phase-to-ground quantities are available with all other connection types. See SENTRON PAC5100(5200 Device Manual, chapter 4, section "Measurands Depending on the Connection Type".

1.2.6.12 Register 0392 to 0399: Data/Time for Last Period PQ Calculation

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Register 0392 to 0395: Data/Time for Last Period PQ Calculation

Data type: Data/time

Table 1-15 Register 0392 to 0395: Data/Time for Last Period PQ Calculation

Register	Type of Information	Remark
0392	Milliseconds	see chapter 1.2.5.2
0393	Hours/minutes	
0394	Month/day	
0395	Time status/year	

Register 0396 to 0399: Data/Time for Last Period PQ Calculation for Frequency (Configurable Period = 30 s to 2 h)

Data type: Data/time

Table 1-16 Register 0396 to 0399: Data/Time for Last Period PQ Calculation

Register	Type of Information	Remark
0396	Milliseconds	see chapter 1.2.5.2
0397	Hours/minutes	
0398	Month/day	
0399	Time status/year	

1.2.6.13 Registers 0401 to 0510: PQ Measured Values – Average Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

The data are calculated within the parameterized time (for example 30 s, 1 min etc.).

Data type: Measured value

Table 1-17 Registers 0401 to 0510: PQ Measured Values – Average Values

Register	Type of Information	Remark	Unit
0401	PQ_Va	Voltage a-N	V
0403	PQ_Vb	Voltage b-N	V
0405	PQ_Vc	Voltage c-N	V
0407	PQ_Vab	Voltage a-b	V
0409	PQ_Vbc	Voltage b-c	V
0411	PQ_Vca	Voltage c-a	V
0413	PQ_Ia	Current a	A
0415	PQ_Ib	Current b	A
0417	PQ_Ic	Current c	A
0419	PQ_VN	Voltage neutral conductor	V
0421	PQ_Vavg	Mean value of voltage (P-N)	V
0423	PQ_IN	Current neutral conductor	A
0425	PQ_Iavg	Mean value of currents	A
0427	PQ_Pa	Active power a	W
0429	PQ_Pb	Active power b	W
0431	PQ_Pc	Active power c	W
0433	PQ_P	Active power	W
0435	PQ_Qa	Reactive power a	var
0437	PQ_Qb	Reactive power b	var
0439	PQ_Qc	Reactive power c	var
0441	PQ_Q	Reactive Power	var
0443	PQ_Sa	Apparent power a	VA

Table 1-17 Registers 0401 to 0510: PQ Measured Values – Average Values (cont.)

Register	Type of Information	Remark	Unit
0445	PQ_Sb	Apparent power b	VA
0447	PQ_Sc	Apparent power c	VA
0449	PQ_S	Apparent power	VA
0451	PQ_cos φ (a)	Active power factor a	-
0453	PQ_cos φ (b)	Active power factor b	-
0455	PQ_cos φ (c)	Active power factor c	-
0457	PQ_cos φ	Active power factor	-
0459	PQ_PFa	Power factor a	-
0461	PQ_PFb	Power factor b	-
0463	PQ_PFc	Power factor c	-
0465	PQ_PF	Power factor	-
0467	PQ_ φ a	Phase angle a	° (degree)
0469	PQ_ φ b	Phase angle b	° (degree)
0471	PQ_ φ c	Phase angle c	° (degree)
0473	PQ_ φ	Phase angle	° (degree)
0475	PQ_f	Power frequency	Hz
0477	PQ_U ₂	Unbalanced voltage	%
0479	PQ_Iunbal	Unbalanced current	%
0481	PQ_Freq_10s	Frequency The period for calculating the power frequency is 10 s.	Hz
0483	PQ_THDS (Va/Vab)	Voltage a/ab THDS	-
0485	PQ_THDS (Vb/Vbc)	Voltage b/bc THDS	-
0487	PQ_THDS (Vc/Vca)	Voltage c/ca THDS	-
0489	PQ_THDS (Ia)	Current a THDS	-
0491	PQ_THDS (Ib)	Current b THDS	-
0493	PQ_THDS (Ic)	Current c THDS	-

Table 1-17 Registers 0401 to 0510: PQ Measured Values – Average Values (cont.)

Register	Type of Information	Remark	Unit
0495	PQ_Voltage (φ_{12})	Angle Vab-Vbc	° (degree)
0497	PQ_Voltage (φ_{13})	Angle Vab-Vca	° (degree)
0499	PQ_Current (φ_{12})	Angle Ia-Ib	° (degree)
0501	PQ_Current (φ_{13})	Angle Ia-Ic	° (degree)
0503	PQ_Q1a	Reactive power (A)_Fundamental	var
0505	PQ_Q1b	Reactive power (B)_Fundamental	var
0507	PQ_Q1c	Reactive power (C)_Fundamental	var
0509	PQ_Q1	Reactive power (Σ)_Fundamental	var

1.2.6.14 Registers 0531 to 0640: PQ Measured Values – Minimum Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

The data are calculated within the parameterized time (for example 30 s, 1 min etc.).

Data type: Measured value

Table 1-18 Registers 0531 to 0640: PQ Measured Values – Minimum Values

Register	Type of Information	Remark	Unit
0531	PQ_Va_min	Voltage a-N	V
0533	PQ_Vb_min	Voltage b-N	V
0535	PQ_Vc_min	Voltage c-N	V
0537	PQ_Vab_min	Voltage a-b	V
0539	PQ_Vbc_min	Voltage b-c	V
0541	PQ_Vca_min	Voltage c-a	V
0543	PQ_Ia_min	Current a	A
0545	PQ_Ib_min	Current b	A
0547	PQ_Ic_min	Current c	A
0549	PQ_VN_min	Voltage neutral conductor	V
0551	PQ_Vavg_min	Mean value of voltage (P-N)	V
0553	PQ_IN_min	Current neutral conductor	A
0555	PQ_Iavg_min	Mean value of currents	A
0557	PQ_Pa_min	Active power a	W
0559	PQ_Pb_min	Active power b	W
0561	PQ_Pc_min	Active power c	W
0563	PQ_P_min	Active power	W
0565	PQ_Qa_min	Reactive power a	var
0567	PQ_Qb_min	Reactive power b	var
0569	PQ_Qc_min	Reactive power c	var
0571	PQ_Q_min	Reactive power	var
0573	PQ_Sa_min	Apparent power a	VA

Table 1-18 Registers 0531 to 0640: PQ Measured Values – Minimum Values (cont.)

Register	Type of Information	Remark	Unit
0575	PQ_Sb_min	Apparent power b	VA
0577	PQ_Sc_min	Apparent power c	VA
0579	PQ_S_min	Apparent power	VA
0581	PQ_cos φ (a)_min	Active power factor a	-
0583	PQ_cos φ (b)_min	Active power factor b	-
0585	PQ_cos φ (c)_min	Active power factor c	-
0587	PQ_cos φ _min	Active power factor	-
0589	PQ_PFa_min	Power factor a	-
0591	PQ_PFb_min	Power factor b	-
0593	PQ_PFc_min	Power factor c	-
0595	PQ_PF_min	Power factor	-
0597	PQ_ φ a_min	Phase angle a	° (degree)
0599	PQ_ φ b_min	Phase angle b	° (degree)
0601	PQ_ φ c_min	Phase angle c	° (degree)
0603	PQ_ φ _min	Phase angle	° (degree)
0605	PQ_f_min	Power frequency	Hz
0607	PQ_U ₂ _min	Unbalanced voltage	%
0609	PQ_lunbal_min	Unbalanced current	%
0611	PQ_Freq_10s_min	Frequency The period for calculating the power frequency is 10 s.	Hz
0613	PQ_THDS (Va/Vab)_min	Voltage a/ab THDS	-
0615	PQ_THDS (Vb/Vbc)_min	Voltage b/bc THDS	-
0617	PQ_THDS (Vc/Vca)_min	Voltage c/ca THDS	-
0619	PQ_THDS (Ia)_min	Current a THDS	-
0621	PQ_THDS (Ib)_min	Current b THDS	-
0623	PQ_THDS (Ic)_min	Current c THDS	-

Table 1-18 Registers 0531 to 0640: PQ Measured Values – Minimum Values (cont.)

Register	Type of Information	Remark	Unit
0625	PQ_Voltage (φ_{12})_min	Angle Vab-Vbc	° (degree)
0627	PQ_Voltage (φ_{13})_min	Angle Vab-Vca	° (degree)
0629	PQ_Current (φ_{12})_min	Angle Ia-Ib	° (degree)
0631	PQ_Current (φ_{13})_min	Angle Ia-Ic	° (degree)
0633	PQ_Q1a_min	Reactive power (A)_Fundamental	var
0635	PQ_Q1b_min	Reactive power (B)_Fundamental	var
0637	PQ_Q1c_min	Reactive power (C)_Fundamental	var
0639	PQ_Q1_min	Reactive power (Σ)_Fundamental	var

1.2.6.15 Registers 0651 to 0760: PQ Measured Values – Maximum Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

The data are calculated within the parameterized time (for example 30 s, 1 min etc.).

Data type: Measured value

Table 1-19 Registers 0651 to 0760: PQ Measured Values – Maximum Values

Register	Type of Information	Remark	Unit
0651	PQ_Va_max	Voltage a-N	V
0653	PQ_Vb_max	Voltage b-N	V
0655	PQ_Vc_max	Voltage c-N	V
0657	PQ_Vab_max	Voltage a-b	V
0659	PQ_Vbc_max	Voltage b-c	V
0661	PQ_Vca_max	Voltage c-a	V
0663	PQ_Ia_max	Current a	A
0665	PQ_Ib_max	Current b	A
0667	PQ_Ic_max	Current c	A
0669	PQ_VN_max	Voltage neutral conductor	V
0671	PQ_Vavg_max	Mean value of voltage (P-N)	V
0673	PQ_IN_max	Current neutral conductor	A
0675	PQ_Iavg_max	Mean value of currents	A
0677	PQ_Pa_max	Active power a	W
0679	PQ_Pb_max	Active power b	W
0681	PQ_Pc_max	Active power c	W
0683	PQ_P_max	Active power	W
0685	PQ_Qa_max	Reactive power a	var
0687	PQ_Qb_max	Reactive power b	var
0689	PQ_Qc_max	Reactive power c	var
0691	PQ_Q_max	Reactive power	var
0693	PQ_Sa_max	Apparent power a	VA

Table 1-19 Registers 0651 to 0760: PQ Measured Values – Maximum Values (cont.)

Register	Type of Information	Remark	Unit
0695	PQ_Sb_max	Apparent power b	VA
0697	PQ_Sc_max	Apparent power c	VA
0699	PQ_S_max	Apparent power	VA
0701	PQ_cos φ (a)_max	Active power factor a	-
0703	PQ_cos φ (b)_max	Active power factor b	-
0705	PQ_cos φ (c)_max	Active power factor c	-
0707	PQ_cos φ _max	Active power factor	-
0709	PQ_PFa_max	Power factor a	-
0711	PQ_PFb_max	Power factor b	-
0713	PQ_PFc_max	Power factor c	-
0715	PQ_PF_max	Power factor	-
0717	PQ_ φ a_max	Phase angle a	° (degree)
0719	PQ_ φ b_max	Phase angle b	° (degree)
0721	PQ_ φ c_max	Phase angle c	° (degree)
0723	PQ_ φ _max	Phase angle	° (degree)
0725	PQ_f_max	Power frequency	Hz
0727	PQ_U ₂ _max	Unbalanced voltage	%
0729	PQ_Iunbal_max	Unbalanced current	%
0731	PQ_Freq_10s_max	Frequency The period for calculating the power frequency is 10 s.	Hz
0733	PQ_THDS (Va/Vab)_max	Voltage a/ab THDS	-
0735	PQ_THDS (Vb/Vbc)_max	Voltage b/bc THDS	-
0737	PQ_THDS (Vc/Vca)_max	Voltage c/ca THDS	-
0739	PQ_THDS (Ia)_max	Current a THDS	-
0741	PQ_THDS (Ib)_max	Current b THDS	-
0743	PQ_THDS (Ic)_max	Current c THDS	-

Table 1-19 Registers 0651 to 0760: PQ Measured Values – Maximum Values (cont.)

Register	Type of Information	Remark	Unit
0745	PQ_Voltage (φ_{12})_max	Angle Vab-Vbc	° (degree)
0747	PQ_Voltage (φ_{13})_max	Angle Vab-Vca	° (degree)
0749	PQ_Current (φ_{12})_max	Angle Ia-Ib	° (degree)
0751	PQ_Current (φ_{13})_max	Angle Ia-Ic	° (degree)
0753	PQ_Q1a_max	Reactive power (A)_Fundamental	var
0755	PQ_Q1b_max	Reactive power (B)_Fundamental	var
0757	PQ_Q1c_max	Reactive power (C)_Fundamental	var
0759	PQ_Q1_max	Reactive power (Σ)_Fundamental	var

1.2.6.16 Registers 0801 to 0846: Energy Counters

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Register 0801 to 0802: Energy per Counter Pulse

Data type: Measured value

Table 1-20 Register 0801 to 0802: Energy per Counter Pulse

Register	Type of Information	Remark	Unit
0801	PulseQuantity	Conversion factor of counter pulses into energy values	Wh per pulse, varh per pulse or VAh per pulse

Registers 0803 to 0806: Counter Value Status

Data type: Counter (quality information)

Table 1-21 Registers 0803 to 0806: Counter Value Status

Register	Type of Information	Remark	Unit
0803/2 ⁰	Status 1	Status of counters WPa_Demand	-
0803/2 ²	Status 2	Status of counters WPb_Demand	-
0803/2 ⁴	Status 3	Status of counters WPa_Demand	-
0803/2 ⁶	Status 4	Status of counters WP_Demand	-
0803/2 ⁸	Status 5	Status of counters WPa_Supply	-
0803/2 ¹⁰	Status 6	Status of counters WPb_Supply	-
0803/2 ¹²	Status 7	Status of counters WPa_Supply	-
0803/2 ¹⁴	Status 8	Status of counters WP_Supply	-
0804/2 ⁰	Status 9	Status of counters WQa_inductive	-
0804/2 ²	Status 10	Status of counters WQb_inductive	-
0804/2 ⁴	Status 11	Status of counters WQc_inductive	-
0804/2 ⁶	Status 12	Status of counters WQ_inductive	-
0804/2 ⁸	Status 13	Status of counters WQa_capacitive	-
0804/2 ¹⁰	Status 14	Status of counters WQb_capacitive	-
0804/2 ¹²	Status 15	Status of counters WQc_capacitive	-

Table 1-21 Registers 0803 to 0806: Counter Value Status (cont.)

Register	Type of Information	Remark	Unit
0804/2 ¹⁴	Status 16	Status of counters WQ_capacitive	-
0805/2 ⁰	Status 17	Status of counters WSa	-
0805/2 ²	Status 18	Status of counters WSb	-
0805/2 ⁴	Status 19	Status of counters WSc	-
0805/2 ⁶	Status 20	Status of counters WS	-
0805/2 ⁸ to 0805/2 ¹⁵	Reserved	= 0	-
0806	Reserved	= 0	-

Registers 0807 to 0846: Counter Pulses

Data type: Counter

Table 1-22 Registers 0807 to 0846: Counter Pulses

Register	Type of Information	Remark	Unit
0807	WPa_dmd	Active energy based on active power Pa Demand	Pulse
0809	WPb_dmd	Active energy based on active power Pb Demand	Pulse
0811	WPc_dmd	Active energy based on active power Pc Demand	Pulse
0813	WP_dmd	Active energy based on active power P Demand	Pulse
0815	WPa_sup	Active energy based on active power Pa Supply	Pulse
0817	WPb_sup	Active energy based on active power Pb Supply	Pulse
0819	WPc_sup	Active energy based on active power Pc Supply	Pulse
0821	WP_sup	Active energy based on active power P Supply	Pulse
0823	WQa_ind	Reactive energy based on reactive power Qa inductive	Pulse

Table 1-22 Registers 0807 to 0846: Counter Pulses (cont.)

Register	Type of Information	Remark	Unit
0825	WQb_ind	Reactive energy based on reactive power Qb inductive	Pulse
0827	WQc_ind	Reactive energy based on reactive power Qc inductive	Pulse
0829	WQ_ind	Reactive energy based on reactive power Q inductive	Pulse
0831	WQa_cap	Reactive energy based on reactive power Qa capacitive	Pulse
0833	WQb_cap	Reactive energy based on reactive power Qb capacitive	Pulse
0835	WQc_cap	Reactive energy based on reactive power Qc capacitive	Pulse
0837	WQ_cap	Reactive energy based on reactive power Q capacitive	Pulse
0839	WSa	Apparent energy based on apparent power Sa	Pulse
0841	WSb	Apparent energy based on apparent power Sb	Pulse
0843	WSc	Apparent energy based on apparent power Sc	Pulse
0845	WS	Apparent energy based on apparent power S	Pulse

1.2.6.17 Registers 1001 to 1280: Harmonics – Voltage Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Calculation period: 10/12 cycle (50Hz/60Hz)

Network types: harmonic ph-n is available if 3W used; harmonic ph-ph is available if 4W is used.

Data type: Measured value

Table 1-23 Registers 1001 to 1280: Harmonics – Voltage Values

Register	Type of Information	Remark	Unit
1001	H_Va-1/H_Vab-1	1. Harmonic, voltage value, a-N, ab (Basic wave)	V
1003	H_Va-2/H_Vab-2	2. Harmonic, voltage value, a-N, ab	V/%
1005	H_Va-3/H_Vab-3	3. Harmonic, voltage value, a-N, ab	V/%
1007	H_Va-4/H_Vab-4	4. Harmonic, voltage value, a-N, ab	V/%
1009	H_Va-5/H_Vab-5	5. Harmonic, voltage value, a-N, ab	V/%
1011	H_Va-6/H_Vab-6	6. Harmonic, voltage value, a-N, ab	V/%
1013	H_Va-7/H_Vab-7	7. Harmonic, voltage value, a-N, ab	V/%
1015	H_Va-8/H_Vab-8	8. Harmonic, voltage value, a-N, ab	V/%
1017	H_Va-9/H_Vab-9	9. Harmonic, voltage value, a-N, ab	V/%
1019	H_Va-10/H_Vab-10	10. Harmonic, voltage value, a-N, ab	V/%
1021	H_Va-11/H_Vab-11	11. Harmonic, voltage value, a-N, ab	V/%
1023	H_Va-12/H_Vab-12	12. Harmonic, voltage value, a-N, ab	V/%
1025	H_Va-13/H_Vab-13	13. Harmonic, voltage value, a-N, ab	V/%
1027	H_Va-14/H_Vab-14	14. Harmonic, voltage value, a-N, ab	V/%
1029	H_Va-15/H_Vab-15	15. Harmonic, voltage value, a-N, ab	V/%
1031	H_Va-16/H_Vab-16	16. Harmonic, voltage value, a-N, ab	V/%
1033	H_Va-17/H_Vab-17	17. Harmonic, voltage value, a-N, ab	V/%
1035	H_Va-18/H_Vab-18	18. Harmonic, voltage value, a-N, ab	V/%
1037	H_Va-19/H_Vab-19	19. Harmonic, voltage value, a-N, ab	V/%
1039	H_Va-20/H_Vab-20	20. Harmonic, voltage value, a-N, ab	V/%
1041	H_Va-21/H_Vab-21	21. Harmonic, voltage value, a-N, ab	V/%

Table 1-23 Registers 1001 to 1280: Harmonics – Voltage Values (cont.)

Register	Type of Information	Remark	Unit
1043	H_Va-22/H_Vab-22	22. Harmonic, voltage value, a-N, ab	V/%
1045	H_Va-23/H_Vab-23	23. Harmonic, voltage value, a-N, ab	V/%
1047	H_Va-24/H_Vab-24	24. Harmonic, voltage value, a-N, ab	V/%
1049	H_Va-25/H_Vab-25	25. Harmonic, voltage value, a-N, ab	V/%
1051	H_Va-26/H_Vab-26	26. Harmonic, voltage value, a-N, ab	V/%
1053	H_Va-27/H_Vab-27	27. Harmonic, voltage value, a-N, ab	V/%
1055	H_Va-28/H_Vab-28	28. Harmonic, voltage value, a-N, ab	V/%
1057	H_Va-29/H_Vab-29	29. Harmonic, voltage value, a-N, ab	V/%
1059	H_Va-30/H_Vab-30	30. Harmonic, voltage value, a-N, ab	V/%
1061	H_Va-31/H_Vab-31	31. Harmonic, voltage value, a-N, ab	V/%
1063	H_Va-32/H_Vab-32	32. Harmonic, voltage value, a-N, ab	V/%
1065	H_Va-33/H_Vab-33	33. Harmonic, voltage value, a-N, ab	V/%
1067	H_Va-34/H_Vab-34	34. Harmonic, voltage value, a-N, ab	V/%
1069	H_Va-35/H_Vab-35	35. Harmonic, voltage value, a-N, ab	V/%
1071	H_Va-36/H_Vab-36	36. Harmonic, voltage value, a-N, ab	V/%
1073	H_Va-37/H_Vab-37	37. Harmonic, voltage value, a-N, ab	V/%
1075	H_Va-38/H_Vab-38	38. Harmonic, voltage value, a-N, ab	V/%
1077	H_Va-39/H_Vab-39	39. Harmonic, voltage value, a-N, ab	V/%
1079	H_Va-40/H_Vab-40	40. Harmonic, voltage value, a-N, ab	V/%
1101	H_Vb-1/H_Vbc-1	1. Harmonic, voltage value, b-N, bc (Basic wave)	V
1103	H_Vb-2/H_Vbc-2	2. Harmonic, voltage value, b-N, bc	V/%
1105	H_Vb-3/H_Vbc-3	3. Harmonic, voltage value, b-N, bc	V/%
1107	H_Vb-4/H_Vbc-4	4. Harmonic, voltage value, b-N, bc	V/%
1109	H_Vb-5/H_Vbc-5	5. Harmonic, voltage value, b-N, bc	V/%
1111	H_Vb-6/H_Vbc-6	6. Harmonic, voltage value, b-N, bc	V/%
1113	H_Vb-7/H_Vbc-7	7. Harmonic, voltage value, b-N, bc	V/%

Table 1-23 Registers 1001 to 1280: Harmonics – Voltage Values (cont.)

Register	Type of Information	Remark	Unit
1115	H_Vb-8/H_Vbc-8	8. Harmonic, voltage value, b-N, bc	V/%
1117	H_Vb-9/H_Vbc-9	9. Harmonic, voltage value, b-N, bc	V/%
1119	H_Vb-10/H_Vbc-10	10. Harmonic, voltage value, b-N, bc	V/%
1121	H_Vb-11/H_Vbc-11	11. Harmonic, voltage value, b-N, bc	V/%
1123	H_Vb-12/H_Vbc-12	12. Harmonic, voltage value, b-N, bc	V/%
1125	H_Vb-13/H_Vbc-13	13. Harmonic, voltage value, b-N, bc	V/%
1127	H_Vb-14/H_Vbc-14	14. Harmonic, voltage value, b-N, bc	V/%
1129	H_Vb-15/H_Vbc-15	15. Harmonic, voltage value, b-N, bc	V/%
1131	H_Vb-16/H_Vbc-16	16. Harmonic, voltage value, b-N, bc	V/%
1133	H_Vb-17/H_Vbc-17	17. Harmonic, voltage value, b-N, bc	V/%
1135	H_Vb-18/H_Vbc-18	18. Harmonic, voltage value, b-N, bc	V/%
1137	H_Vb-19/H_Vbc-19	19. Harmonic, voltage value, b-N, bc	V/%
1139	H_Vb-20/H_Vbc-20	20. Harmonic, voltage value, b-N, bc	V/%
1141	H_Vb-21/H_Vbc-21	21. Harmonic, voltage value, b-N, bc	V/%
1143	H_Vb-22/H_Vbc-22	22. Harmonic, voltage value, b-N, bc	V/%
1145	H_Vb-23/H_Vbc-23	23. Harmonic, voltage value, b-N, bc	V/%
1147	H_Vb-24/H_Vbc-24	24. Harmonic, voltage value, b-N, bc	V/%
1149	H_Vb-25/H_Vbc-25	25. Harmonic, voltage value, b-N, bc	V/%
1151	H_Vb-26/H_Vbc-26	26. Harmonic, voltage value, b-N, bc	V/%
1153	H_Vb-27/H_Vbc-27	27. Harmonic, voltage value, b-N, bc	V/%
1155	H_Vb-28/H_Vbc-28	28. Harmonic, voltage value, b-N, bc	V/%
1157	H_Vb-29/H_Vbc-29	29. Harmonic, voltage value, b-N, bc	V/%
1159	H_Vb-30/H_Vbc-30	30. Harmonic, voltage value, b-N, bc	V/%
1161	H_Vb-31/H_Vbc-31	31. Harmonic, voltage value, b-N, bc	V/%
1163	H_Vb-32/H_Vbc-32	32. Harmonic, voltage value, b-N, bc	V/%
1165	H_Vb-33/H_Vbc-33	33. Harmonic, voltage value, b-N, bc	V/%

Table 1-23 Registers 1001 to 1280: Harmonics – Voltage Values (cont.)

Register	Type of Information	Remark	Unit
1167	H_Vb-34/H_Vbc-34	34. Harmonic, voltage value, b-N, bc	V/%
1169	H_Vb-35/H_Vbc-35	35. Harmonic, voltage value, b-N, bc	V/%
1171	H_Vb-36/H_Vbc-36	36. Harmonic, voltage value, b-N, bc	V/%
1173	H_Vb-37/H_Vbc-37	37. Harmonic, voltage value, b-N, bc	V/%
1175	H_Vb-38/H_Vbc-38	38. Harmonic, voltage value, b-N, bc	V/%
1177	H_Vb-39/H_Vbc-39	39. Harmonic, voltage value, b-N, bc	V/%
1179	H_Vb-40/H_Vbc-40	40. Harmonic, voltage value, b-N, bc	V/%
1201	H_Vc-1/H_Vca-1	1. Harmonic, voltage value, c-N, ca (Basic wave)	V
1203	H_Vc-2/H_Vca-2	2. Harmonic, voltage value, c-N, ca	V/%
1205	H_Vc-3/H_Vca-3	3. Harmonic, voltage value, c-N, ca	V/%
1207	H_Vc-4/H_Vca-4	4. Harmonic, voltage value, c-N, ca	V/%
1209	H_Vc-5/H_Vca-5	5. Harmonic, voltage value, c-N, ca	V/%
1211	H_Vc-6/H_Vca-6	6. Harmonic, voltage value, c-N, ca	V/%
1213	H_Vc-7/H_Vca-7	7. Harmonic, voltage value, c-N, ca	V/%
1215	H_Vc-8/H_Vca-8	8. Harmonic, voltage value, c-N, ca	V/%
1217	H_Vc-9/H_Vca-9	9. Harmonic, voltage value, c-N, ca	V/%
1219	H_Vc-10/H_Vca-10	10. Harmonic, voltage value, c-N, ca	V/%
1221	H_Vc-11/H_Vca-11	11. Harmonic, voltage value, c-N, ca	V/%
1223	H_Vc-12/H_Vca-12	12. Harmonic, voltage value, c-N, ca	V/%
1225	H_Vc-13/H_Vca-13	13. Harmonic, voltage value, c-N, ca	V/%
1227	H_Vc-14/H_Vca-14	14. Harmonic, voltage value, c-N, ca	V/%
1229	H_Vc-15/H_Vca-15	15. Harmonic, voltage value, c-N, ca	V/%
1231	H_Vc-16/H_Vca-16	16. Harmonic, voltage value, c-N, ca	V/%
1233	H_Vc-17/H_Vca-17	17. Harmonic, voltage value, c-N, ca	V/%
1235	H_Vc-18/H_Vca-18	18. Harmonic, voltage value, c-N, ca	V/%
1237	H_Vc-19/H_Vca-19	19. Harmonic, voltage value, c-N, ca	V/%

Table 1-23 Registers 1001 to 1280: Harmonics – Voltage Values (cont.)

Register	Type of Information	Remark	Unit
1239	H_Vc-20/H_Vca-20	20. Harmonic, voltage value, c-N, ca	V/%
1241	H_Vc-21/H_Vca-21	21. Harmonic, voltage value, c-N, ca	V/%
1243	H_Vc-22/H_Vca-22	22. Harmonic, voltage value, c-N, ca	V/%
1245	H_Vc-23/H_Vca-23	23. Harmonic, voltage value, c-N, ca	V/%
1247	H_Vc-24/H_Vca-24	24. Harmonic, voltage value, c-N, ca	V/%
1249	H_Vc-25/H_Vca-25	25. Harmonic, voltage value, c-N, ca	V/%
1251	H_Vc-26/H_Vca-26	26. Harmonic, voltage value, c-N, ca	V/%
1253	H_Vc-27/H_Vca-27	27. Harmonic, voltage value, c-N, ca	V/%
1255	H_Vc-28/H_Vca-28	28. Harmonic, voltage value, c-N, ca	V/%
1257	H_Vc-29/H_Vca-29	29. Harmonic, voltage value, c-N, ca	V/%
1259	H_Vc-30/H_Vca-30	30. Harmonic, voltage value, c-N, ca	V/%
1261	H_Vc-31/H_Vca-31	31. Harmonic, voltage value, c-N, ca	V/%
1263	H_Vc-32/H_Vca-32	32. Harmonic, voltage value, c-N, ca	V/%
1265	H_Vc-33/H_Vca-33	33. Harmonic, voltage value, c-N, ca	V/%
1267	H_Vc-34/H_Vca-34	34. Harmonic, voltage value, c-N, ca	V/%
1269	H_Vc-35/H_Vca-35	35. Harmonic, voltage value, c-N, ca	V/%
1271	H_Vc-36/H_Vca-36	36. Harmonic, voltage value, c-N, ca	V/%
1273	H_Vc-37/H_Vca-37	37. Harmonic, voltage value, c-N, ca	V/%
1275	H_Vc-38/H_Vca-38	38. Harmonic, voltage value, c-N, ca	V/%
1277	H_Vc-39/H_Vca-39	39. Harmonic, voltage value, c-N, ca	V/%
1279	H_Vc-40/H_Vca-40	40. Harmonic, voltage value, c-N, ca	V/%

1.2.6.18 Registers 1401 to 1680: Harmonics – Current Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Calculation period: 10/12 cycle (50 Hz/60 Hz)

Data type: Measured value

Table 1-24 Registers 1401 to 1680: Harmonics – Current Values

Register	Type of Information	Remark	Unit
1401	H_la-1	1. Harmonic, current value, a-N (Basic wave)	A
1403	H_la-2	2. Harmonic, current value, a-N	A
1405	H_la-3	3. Harmonic, current value, a-N	A
1407	H_la-4	4. Harmonic, current value, a-N	A
1409	H_la-5	5. Harmonic, current value, a-N	A
1411	H_la-6	6. Harmonic, current value, a-N	A
1413	H_la-7	7. Harmonic, current value, a-N	A
1415	H_la-8	8. Harmonic, current value, a-N	A
1417	H_la-9	9. Harmonic, current value, a-N	A
1419	H_la-10	10. Harmonic, current value, a-N	A
1421	H_la-11	11. Harmonic, current value, a-N	A
1423	H_la-12	12. Harmonic, current value, a-N	A
1425	H_la-13	13. Harmonic, current value, a-N	A
1427	H_la-14	14. Harmonic, current value, a-N	A
1429	H_la-15	15. Harmonic, current value, a-N	A
1431	H_la-16	16. Harmonic, current value, a-N	A
1433	H_la-17	17. Harmonic, current value, a-N	A
1435	H_la-18	18. Harmonic, current value, a-N	A
1437	H_la-19	19. Harmonic, current value, a-N	A
1439	H_la-20	20. Harmonic, current value, a-N	A
1441	H_la-21	21. Harmonic, current value, a-N	A
1443	H_la-22	22. Harmonic, current value, a-N	A

Table 1-24 Registers 1401 to 1680: Harmonics – Current Values (cont.)

Register	Type of Information	Remark	Unit
1445	H_la-23	23. Harmonic, current value, a-N	A
1447	H_la-24	24. Harmonic, current value, a-N	A
1449	H_la-25	25. Harmonic, current value, a-N	A
1451	H_la-26	26. Harmonic, current value, a-N	A
1453	H_la-27	27. Harmonic, current value, a-N	A
1455	H_la-28	28. Harmonic, current value, a-N	A
1457	H_la-29	29. Harmonic, current value, a-N	A
1459	H_la-30	30. Harmonic, current value, a-N	A
1461	H_la-31	31. Harmonic, current value, a-N	A
1463	H_la-32	32. Harmonic, current value, a-N	A
1465	H_la-33	33. Harmonic, current value, a-N	A
1467	H_la-34	34. Harmonic, current value, a-N	A
1469	H_la-35	35. Harmonic, current value, a-N	A
1471	H_la-36	36. Harmonic, current value, a-N	A
1473	H_la-37	37. Harmonic, current value, a-N	A
1475	H_la-38	38. Harmonic, current value, a-N	A
1477	H_la-39	39. Harmonic, current value, a-N	A
1479	H_la-40	40. Harmonic, current value, a-N	A
1501	H_lb-1	1. Harmonic, current value, b-N (Basic wave)	A
1503	H_lb-2	2. Harmonic, current value, b-N	A
1505	H_lb-3	3. Harmonic, current value, b-N	A
1507	H_lb-4	4. Harmonic, current value, b-N	A
1509	H_lb-5	5. Harmonic, current value, b-N	A
1511	H_lb-6	6. Harmonic, current value, b-N	A
1513	H_lb-7	7. Harmonic, current value, b-N	A
1515	H_lb-8	8. Harmonic, current value, b-N	A

Table 1-24 Registers 1401 to 1680: Harmonics – Current Values (cont.)

Register	Type of Information	Remark	Unit
1517	H_Ib-9	9. Harmonic, current value, b-N	A
1519	H_Ib-10	10. Harmonic, current value, b-N	A
1521	H_Ib-11	11. Harmonic, current value, b-N	A
1523	H_Ib-12	12. Harmonic, current value, b-N	A
1525	H_Ib-13	13. Harmonic, current value, b-N	A
1527	H_Ib-14	14. Harmonic, current value, b-N	A
1529	H_Ib-15	15. Harmonic, current value, b-N	A
1531	H_Ib-16	16. Harmonic, current value, b-N	A
1533	H_Ib-17	17. Harmonic, current value, b-N	A
1535	H_Ib-18	18. Harmonic, current value, b-N	A
1537	H_Ib-19	19. Harmonic, current value, b-N	A
1539	H_Ib-20	20. Harmonic, current value, b-N	A
1541	H_Ib-21	21. Harmonic, current value, b-N	A
1543	H_Ib-22	22. Harmonic, current value, b-N	A
1545	H_Ib-23	23. Harmonic, current value, b-N	A
1547	H_Ib-24	24. Harmonic, current value, b-N	A
1549	H_Ib-25	25. Harmonic, current value, b-N	A
1551	H_Ib-26	26. Harmonic, current value, b-N	A
1553	H_Ib-27	27. Harmonic, current value, b-N	A
1555	H_Ib-28	28. Harmonic, current value, b-N	A
1557	H_Ib-29	29. Harmonic, current value, b-N	A
1559	H_Ib-30	30. Harmonic, current value, b-N	A
1561	H_Ib-31	31. Harmonic, current value, b-N	A
1563	H_Ib-32	32. Harmonic, current value, b-N	A
1565	H_Ib-33	33. Harmonic, current value, b-N	A
1567	H_Ib-34	34. Harmonic, current value, b-N	A

Table 1-24 Registers 1401 to 1680: Harmonics – Current Values (cont.)

Register	Type of Information	Remark	Unit
1569	H_lb-35	35. Harmonic, current value, b-N	A
1571	H_lb-36	36. Harmonic, current value, b-N	A
1573	H_lb-37	37. Harmonic, current value, b-N	A
1575	H_lb-38	38. Harmonic, current value, b-N	A
1577	H_lb-39	39. Harmonic, current value, b-N	A
1579	H_lb-40	40. Harmonic, current value, b-N	A
1601	H_lc-1	1. Harmonic, current value, c-N (Basic wave)	A
1603	H_lc-2	2. Harmonic, current value, c-N	A
1605	H_lc-3	3. Harmonic, current value, c-N	A
1607	H_lc-4	4. Harmonic, current value, c-N	A
1609	H_lc-5	5. Harmonic, current value, c-N	A
1611	H_lc-6	6. Harmonic, current value, c-N	A
1613	H_lc-7	7. Harmonic, current value, c-N	A
1615	H_lc-8	8. Harmonic, current value, c-N	A
1617	H_lc-9	9. Harmonic, current value, c-N	A
1619	H_lc-10	10. Harmonic, current value, c-N	A
1621	H_lc-11	11. Harmonic, current value, c-N	A
1623	H_lc-12	12. Harmonic, current value, c-N	A
1625	H_lc-13	13. Harmonic, current value, c-N	A
1627	H_lc-14	14. Harmonic, current value, c-N	A
1629	H_lc-15	15. Harmonic, current value, c-N	A
1631	H_lc-16	16. Harmonic, current value, c-N	A
1633	H_lc-17	17. Harmonic, current value, c-N	A
1635	H_lc-18	18. Harmonic, current value, c-N	A
1637	H_lc-19	19. Harmonic, current value, c-N	A
1639	H_lc-20	20. Harmonic, current value, c-N	A

Table 1-24 Registers 1401 to 1680: Harmonics – Current Values (cont.)

Register	Type of Information	Remark	Unit
1641	H_Ic-21	21. Harmonic, current value, c-N	A
1643	H_Ic-22	22. Harmonic, current value, c-N	A
1645	H_Ic-23	23. Harmonic, current value, c-N	A
1647	H_Ic-24	24. Harmonic, current value, c-N	A
1649	H_Ic-25	25. Harmonic, current value, c-N	A
1651	H_Ic-26	26. Harmonic, current value, c-N	A
1653	H_Ic-27	27. Harmonic, current value, c-N	A
1655	H_Ic-28	28. Harmonic, current value, c-N	A
1657	H_Ic-29	29. Harmonic, current value, c-N	A
1659	H_Ic-30	30. Harmonic, current value, c-N	A
1661	H_Ic-31	31. Harmonic, current value, c-N	A
1663	H_Ic-32	32. Harmonic, current value, c-N	A
1665	H_Ic-33	33. Harmonic, current value, c-N	A
1667	H_Ic-34	34. Harmonic, current value, c-N	A
1669	H_Ic-35	35. Harmonic, current value, c-N	A
1671	H_Ic-36	36. Harmonic, current value, c-N	A
1673	H_Ic-37	37. Harmonic, current value, c-N	A
1675	H_Ic-38	38. Harmonic, current value, c-N	A
1677	H_Ic-39	39. Harmonic, current value, c-N	A
1679	H_Ic-40	40. Harmonic, current value, c-N	A

1.2.6.19 Registers 1801 to 2080: PQ Calculation for Harmonic (Average Values) – Voltage Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

The data are calculated within the parameterized time (for example 30 s, 1 min etc.).

Network types: harmonic ph-n is available if 3W used; harmonic ph-ph is available if 4W is used.

Data type: Measured value

Table 1-25 Registers 1801 to 2080: PQ Calculation for Harmonics (Average Values) – Voltage Values

Register	Type of Information	Remark	Unit
1801	H_Va/Vab-1_AVG	1. Harmonic (average value), voltage value, a-N, ab (Basic wave)	V
1803	H_Va/Vab-2_AVG	2. Harmonic (average value), voltage value, a-N, ab	V/%
1805	H_Va/Vab-3_AVG	3. Harmonic (average value), voltage value, a-N, ab	V/%
1807	H_Va/Vab-4_AVG	4. Harmonic (average value), voltage value, a-N, ab	V/%
1809	H_Va/Vab-5_AVG	5. Harmonic (average value), voltage value, a-N, ab	V/%
1811	H_Va/Vab-6_AVG	6. Harmonic (average value), voltage value, a-N, ab	V/%
1813	H_Va/Vab-7_AVG	7. Harmonic (average value), voltage value, a-N, ab	V/%
1815	H_Va/Vab-8_AVG	8. Harmonic (average value), voltage value, a-N, ab	V/%
1817	H_Va/Vab-9_AVG	9. Harmonic (average value), voltage value, a-N, ab	V/%
1819	H_Va/Vab-10_AVG	10. Harmonic (average value), voltage value, a-N, ab	V/%
1821	H_Va/Vab-11_AVG	11. Harmonic (average value), voltage value, a-N, ab	V/%
1823	H_Va/Vab-12_AVG	12. Harmonic (average value), voltage value, a-N, ab	V/%
1825	H_Va/Vab-13_AVG	13. Harmonic (average value), voltage value, a-N, ab	V/%
1827	H_Va/Vab-14_AVG	14. Harmonic (average value), voltage value, a-N, ab	V/%
1829	H_Va/Vab-15_AVG	15. Harmonic (average value), voltage value, a-N, ab	V/%
1831	H_Va/Vab-16_AVG	16. Harmonic (average value), voltage value, a-N, ab	V/%
1833	H_Va/Vab-17_AVG	17. Harmonic (average value), voltage value, a-N, ab	V/%
1835	H_Va/Vab-18_AVG	18. Harmonic (average value), voltage value, a-N, ab	V/%
1837	H_Va/Vab-19_AVG	19. Harmonic (average value), voltage value, a-N, ab	V/%
1839	H_Va/Vab-20_AVG	20. Harmonic (average value), voltage value, a-N, ab	V/%

Table 1-25 Registers 1801 to 2080: PQ Calculation for Harmonics (Average Values) – Voltage Values

Register	Type of Information	Remark	Unit
1841	H_Va/Vab-21_AVG	21. Harmonic (average value), voltage value, a-N, ab	V/%
1843	H_Va/Vab-22_AVG	22. Harmonic (average value), voltage value, a-N, ab	V/%
1845	H_Va/Vab-23_AVG	23. Harmonic (average value), voltage value, a-N, ab	V/%
1847	H_Va/Vab-24_AVG	24. Harmonic (average value), voltage value, a-N, ab	V/%
1849	H_Va/Vab-25_AVG	25. Harmonic (average value), voltage value, a-N, ab	V/%
1851	H_Va/Vab-26_AVG	26. Harmonic (average value), voltage value, a-N, ab	V/%
1853	H_Va/Vab-27_AVG	27. Harmonic (average value), voltage value, a-N, ab	V/%
1855	H_Va/Vab-28_AVG	28. Harmonic (average value), voltage value, a-N, ab	V/%
1857	H_Va/Vab-29_AVG	29. Harmonic (average value), voltage value, a-N, ab	V/%
1859	H_Va/Vab-30_AVG	30. Harmonic (average value), voltage value, a-N, ab	V/%
1861	H_Va/Vab-31_AVG	31. Harmonic (average value), voltage value, a-N, ab	V/%
1863	H_Va/Vab-32_AVG	32. Harmonic (average value), voltage value, a-N, ab	V/%
1865	H_Va/Vab-33_AVG	33. Harmonic (average value), voltage value, a-N, ab	V/%
1867	H_Va/Vab-34_AVG	34. Harmonic (average value), voltage value, a-N, ab	V/%
1869	H_Va/Vab-35_AVG	35. Harmonic (average value), voltage value, a-N, ab	V/%
1871	H_Va/Vab-36_AVG	36. Harmonic (average value), voltage value, a-N, ab	V/%
1873	H_Va/Vab-37_AVG	37. Harmonic (average value), voltage value, a-N, ab	V/%
1875	H_Va/Vab-38_AVG	38. Harmonic (average value), voltage value, a-N, ab	V/%
1877	H_Va/Vab-39_AVG	39. Harmonic (average value), voltage value, a-N, ab	V/%
1879	H_Va/Vab-40_AVG	40. Harmonic (average value), voltage value, a-N, ab	V/%
1901	H_Vb/Vbc-1_AVG	1. Harmonic (average value), voltage value, b-N, bc (Basic wave)	V
1903	H_Vb/Vbc-2_AVG	2. Harmonic (average value), voltage value, b-N, bc	V/%
1905	H_Vb/Vbc-3_AVG	3. Harmonic (average value), voltage value, b-N, bc	V/%
1907	H_Vb/Vbc-4_AVG	4. Harmonic (average value), voltage value, b-N, bc	V/%
1909	H_Vb/Vbc-5_AVG	5. Harmonic (average value), voltage value, b-N, bc	V/%

Table 1-25 Registers 1801 to 2080: PQ Calculation for Harmonics (Average Values) – Voltage Values

Register	Type of Information	Remark	Unit
1911	H_Vb/Vbc-6_AVG	6. Harmonic (average value), voltage value, b-N, bc	V/%
1913	H_Vb/Vbc-7_AVG	7. Harmonic (average value), voltage value, b-N, bc	V/%
1915	H_Vb/Vbc-8_AVG	8. Harmonic (average value), voltage value, b-N, bc	V/%
1917	H_Vb/Vbc-9_AVG	9. Harmonic (average value), voltage value, b-N, bc	V/%
1919	H_Vb/Vbc-10_AVG	10. Harmonic (average value), voltage value, b-N, bc	V/%
1921	H_Vb/Vbc-11_AVG	11. Harmonic (average value), voltage value, b-N, bc	V/%
1923	H_Vb/Vbc-12_AVG	12. Harmonic (average value), voltage value, b-N, bc	V/%
1925	H_Vb/Vbc-13_AVG	13. Harmonic (average value), voltage value, b-N, bc	V/%
1927	H_Vb/Vbc-14_AVG	14. Harmonic (average value), voltage value, b-N, bc	V/%
1929	H_Vb/Vbc-15_AVG	15. Harmonic (average value), voltage value, b-N, bc	V/%
1931	H_Vb/Vbc-16_AVG	16. Harmonic (average value), voltage value, b-N, bc	V/%
1933	H_Vb/Vbc-17_AVG	17. Harmonic (average value), voltage value, b-N, bc	V/%
1935	H_Vb/Vbc-18_AVG	18. Harmonic (average value), voltage value, b-N, bc	V/%
1937	H_Vb/Vbc-19_AVG	19. Harmonic (average value), voltage value, b-N, bc	V/%
1939	H_Vb/Vbc-20_AVG	20. Harmonic (average value), voltage value, b-N, bc	V/%
1941	H_Vb/Vbc-21_AVG	21. Harmonic (average value), voltage value, b-N, bc	V/%
1943	H_Vb/Vbc-22_AVG	22. Harmonic (average value), voltage value, b-N, bc	V/%
1945	H_Vb/Vbc-23_AVG	23. Harmonic (average value), voltage value, b-N, bc	V/%
1947	H_Vb/Vbc-24_AVG	24. Harmonic (average value), voltage value, b-N, bc	V/%
1949	H_Vb/Vbc-25_AVG	25. Harmonic (average value), voltage value, b-N, bc	V/%
1951	H_Vb/Vbc-26_AVG	26. Harmonic (average value), voltage value, b-N, bc	V/%
1953	H_Vb/Vbc-27_AVG	27. Harmonic (average value), voltage value, b-N, bc	V/%
1955	H_Vb/Vbc-28_AVG	28. Harmonic (average value), voltage value, b-N, bc	V/%
1957	H_Vb/Vbc-29_AVG	29. Harmonic (average value), voltage value, b-N, bc	V/%
1959	H_Vb/Vbc-30_AVG	30. Harmonic (average value), voltage value, b-N, bc	V/%
1961	H_Vb/Vbc-31_AVG	31. Harmonic (average value), voltage value, b-N, bc	V/%

Table 1-25 Registers 1801 to 2080: PQ Calculation for Harmonics (Average Values) – Voltage Values

Register	Type of Information	Remark	Unit
1963	H_Vb/Vbc-32_AVG	32. Harmonic (average value), voltage value, b-N, bc	V/%
1965	H_Vb/Vbc-33_AVG	33. Harmonic (average value), voltage value, b-N, bc	V/%
1967	H_Vb/Vbc-34_AVG	34. Harmonic (average value), voltage value, b-N, bc	V/%
1969	H_Vb/Vbc-35_AVG	35. Harmonic (average value), voltage value, b-N, bc	V/%
1971	H_Vb/Vbc-36_AVG	36. Harmonic (average value), voltage value, b-N, bc	V/%
1973	H_Vb/Vbc-37_AVG	37. Harmonic (average value), voltage value, b-N, bc	V/%
1975	H_Vb/Vbc-38_AVG	38. Harmonic (average value), voltage value, b-N, bc	V/%
1977	H_Vb/Vbc-39_AVG	39. Harmonic (average value), voltage value, b-N, bc	V/%
1979	H_Vb/Vbc-40_AVG	40. Harmonic (average value), voltage value, b-N, bc	V/%
2001	H_Vc/Vca-1_AVG	1. Harmonic (average value), voltage value, c-N, ca (Basic wave)	V
2003	H_Vc/Vca-2_AVG	2. Harmonic (average value), voltage value, c-N, ca	V/%
2005	H_Vc/Vca-3_AVG	3. Harmonic (average value), voltage value, c-N, ca	V/%
2007	H_Vc/Vca-4_AVG	4. Harmonic (average value), voltage value, c-N, ca	V/%
2009	H_Vc/Vca-5_AVG	5. Harmonic (average value), voltage value, c-N, ca	V/%
2011	H_Vc/Vca-6_AVG	6. Harmonic (average value), voltage value, c-N, ca	V/%
2013	H_Vc/Vca-7_AVG	7. Harmonic (average value), voltage value, c-N, ca	V/%
2015	H_Vc/Vca-8_AVG	8. Harmonic (average value), voltage value, c-N, ca	V/%
2017	H_Vc/Vca-9_AVG	9. Harmonic (average value), voltage value, c-N, ca	V/%
2019	H_Vc/Vca-10_AVG	10. Harmonic (average value), voltage value, c-N, ca	V/%
2021	H_Vc/Vca-11_AVG	11. Harmonic (average value), voltage value, c-N, ca	V/%
2023	H_Vc/Vca-12_AVG	12. Harmonic (average value), voltage value, c-N, ca	V/%
2025	H_Vc/Vca-13_AVG	13. Harmonic (average value), voltage value, c-N, ca	V/%
2027	H_Vc/Vca-14_AVG	14. Harmonic (average value), voltage value, c-N, ca	V/%
2029	H_Vc/Vca-15_AVG	15. Harmonic (average value), voltage value, c-N, ca	V/%
2031	H_Vc/Vca-16_AVG	16. Harmonic (average value), voltage value, c-N, ca	V/%

Table 1-25 Registers 1801 to 2080: PQ Calculation for Harmonics (Average Values) – Voltage Values

Register	Type of Information	Remark	Unit
2033	H_Vc/Vca-17_AVG	17. Harmonic (average value), voltage value, c-N, ca	V/%
2035	H_Vc/Vca-18_AVG	18. Harmonic (average value), voltage value, c-N, ca	V/%
2037	H_Vc/Vca-19_AVG	19. Harmonic (average value), voltage value, c-N, ca	V/%
2039	H_Vc/Vca-20_AVG	20. Harmonic (average value), voltage value, c-N, ca	V/%
2041	H_Vc/Vca-21_AVG	21. Harmonic (average value), voltage value, c-N, ca	V/%
2043	H_Vc/Vca-22_AVG	22. Harmonic (average value), voltage value, c-N, ca	V/%
2045	H_Vc/Vca-23_AVG	23. Harmonic (average value), voltage value, c-N, ca	V/%
2047	H_Vc/Vca-24_AVG	24. Harmonic (average value), voltage value, c-N, ca	V/%
2049	H_Vc/Vca-25_AVG	25. Harmonic (average value), voltage value, c-N, ca	V/%
2051	H_Vc/Vca-26_AVG	26. Harmonic (average value), voltage value, c-N, ca	V/%
2053	H_Vc/Vca-27_AVG	27. Harmonic (average value), voltage value, c-N, ca	V/%
2055	H_Vc/Vca-28_AVG	28. Harmonic (average value), voltage value, c-N, ca	V/%
2057	H_Vc/Vca-29_AVG	29. Harmonic (average value), voltage value, c-N, ca	V/%
2059	H_Vc/Vca-30_AVG	30. Harmonic (average value), voltage value, c-N, ca	V/%
2061	H_Vc/Vca-31_AVG	31. Harmonic (average value), voltage value, c-N, ca	V/%
2063	H_Vc/Vca-32_AVG	32. Harmonic (average value), voltage value, c-N, ca	V/%
2065	H_Vc/Vca-33_AVG	33. Harmonic (average value), voltage value, c-N, ca	V/%
2067	H_Vc/Vca-34_AVG	34. Harmonic (average value), voltage value, c-N, ca	V/%
2069	H_Vc/Vca-35_AVG	35. Harmonic (average value), voltage value, c-N, ca	V/%
2071	H_Vc/Vca-36_AVG	36. Harmonic (average value), voltage value, c-N, ca	V/%
2073	H_Vc/Vca-37_AVG	37. Harmonic (average value), voltage value, c-N, ca	V/%
2075	H_Vc/Vca-38_AVG	38. Harmonic (average value), voltage value, c-N, ca	V/%
2077	H_Vc/Vca-39_AVG	39. Harmonic (average value), voltage value, c-N, ca	V/%
2079	H_Vc/Vca-40_AVG	40. Harmonic (average value), voltage value, c-N, ca	V/%

1.2.6.20 Registers 2201 to 2480: PQ Calculation for Maximum Harmonic – Voltage Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

The data are calculated within the parameterized time (for example 30 s, 1 min etc.).

Data type: Measured value

Table 1-26 Registers 2201 to 2480: PQ Calculation for Harmonics (Maximum Values) – Voltage Values

Register	Type of Information	Remark	Unit
2201	H_Va/Vab-1_MAX	1. Harmonic (maximum value), voltage value, a-N, ab (Basic wave)	V
2203	H_Va/Vab-2_MAX	2. Harmonic (maximum value), voltage value, a-N, ab	V/%
2205	H_Va/Vab-3_MAX	3. Harmonic (maximum value), voltage value, a-N, ab	V/%
2207	H_Va/Vab-4_MAX	4. Harmonic (maximum value), voltage value, a-N, ab	V/%
2209	H_Va/Vab-5_MAX	5. Harmonic (maximum value), voltage value, a-N, ab	V/%
2211	H_Va/Vab-6_MAX	6. Harmonic (maximum value), voltage value, a-N, ab	V/%
2213	H_Va/Vab-7_MAX	7. Harmonic (maximum value), voltage value, a-N, ab	V/%
2215	H_Va/Vab-8_MAX	8. Harmonic (maximum value), voltage value, a-N, ab	V/%
2217	H_Va/Vab-9_MAX	9. Harmonic (maximum value), voltage value, a-N, ab	V/%
2219	H_Va/Vab-10_MAX	10. Harmonic (maximum value), voltage value, a-N, ab	V/%
2221	H_Va/Vab-11_MAX	11. Harmonic (maximum value), voltage value, a-N, ab	V/%
2223	H_Va/Vab-12_MAX	12. Harmonic (maximum value), voltage value, a-N, ab	V/%
2225	H_Va/Vab-13_MAX	13. Harmonic (maximum value), voltage value, a-N, ab	V/%
2227	H_Va/Vab-14_MAX	14. Harmonic (maximum value), voltage value, a-N, ab	V/%
2229	H_Va/Vab-15_MAX	15. Harmonic (maximum value), voltage value, a-N, ab	V/%
2231	H_Va/Vab-16_MAX	16. Harmonic (maximum value), voltage value, a-N, ab	V/%
2233	H_Va/Vab-17_MAX	17. Harmonic (maximum value), voltage value, a-N, ab	V/%
2235	H_Va/Vab-18_MAX	18. Harmonic (maximum value), voltage value, a-N, ab	V/%
2237	H_Va/Vab-19_MAX	19. Harmonic (maximum value), voltage value, a-N, ab	V/%
2239	H_Va/Vab-20_MAX	20. Harmonic (maximum value), voltage value, a-N, ab	V/%
2241	H_Va/Vab-21_MAX	21. Harmonic (maximum value), voltage value, a-N, ab	V/%

Table 1-26 Registers 2201 to 2480: PQ Calculation for Harmonics (Maximum Values) – Voltage Values

Register	Type of Information	Remark	Unit
2243	H_Va/Vab-22_MAX	22. Harmonic (maximum value), voltage value, a-N, ab	V/%
2245	H_Va/Vab-23_MAX	23. Harmonic (maximum value), voltage value, a-N, ab	V/%
2247	H_Va/Vab-24_MAX	24. Harmonic (maximum value), voltage value, a-N, ab	V/%
2249	H_Va/Vab-25_MAX	25. Harmonic (maximum value), voltage value, a-N, ab	V/%
2251	H_Va/Vab-26_MAX	26. Harmonic (maximum value), voltage value, a-N, ab	V/%
2253	H_Va/Vab-27_MAX	27. Harmonic (maximum value), voltage value, a-N, ab	V/%
2255	H_Va/Vab-28_MAX	28. Harmonic (maximum value), voltage value, a-N, ab	V/%
2257	H_Va/Vab-29_MAX	29. Harmonic (maximum value), voltage value, a-N, ab	V/%
2259	H_Va/Vab-30_MAX	30. Harmonic (maximum value), voltage value, a-N, ab	V/%
2261	H_Va/Vab-31_MAX	31. Harmonic (maximum value), voltage value, a-N, ab	V/%
2263	H_Va/Vab-32_MAX	32. Harmonic (maximum value), voltage value, a-N, ab	V/%
2265	H_Va/Vab-33_MAX	33. Harmonic (maximum value), voltage value, a-N, ab	V/%
2267	H_Va/Vab-34_MAX	34. Harmonic (maximum value), voltage value, a-N, ab	V/%
2269	H_Va/Vab-35_MAX	35. Harmonic (maximum value), voltage value, a-N, ab	V/%
2271	H_Va/Vab-36_MAX	36. Harmonic (maximum value), voltage value, a-N, ab	V/%
2273	H_Va/Vab-37_MAX	37. Harmonic (maximum value), voltage value, a-N, ab	V/%
2275	H_Va/Vab-38_MAX	38. Harmonic (maximum value), voltage value, a-N, ab	V/%
2277	H_Va/Vab-39_MAX	39. Harmonic (maximum value), voltage value, a-N, ab	V/%
2279	H_Va/Vab-40_MAX	40. Harmonic (maximum value), voltage value, a-N, ab	V/%
2301	H_Vb/Vbc-1_MAX	1. Harmonic (maximum value), voltage value, b-N, bc (Basic wave)	V
2303	H_Vb/Vbc-2_MAX	2. Harmonic (maximum value), voltage value, b-N, bc	V/%
2305	H_Vb/Vbc-3_MAX	3. Harmonic (maximum value), voltage value, b-N, bc	V/%
2307	H_Vb/Vbc-4_MAX	4. Harmonic (maximum value), voltage value, b-N, bc	V/%
2309	H_Vb/Vbc-5_MAX	5. Harmonic (maximum value), voltage value, b-N, bc	V/%
2311	H_Vb/Vbc-6_MAX	6. Harmonic (maximum value), voltage value, b-N, bc	V/%

Table 1-26 Registers 2201 to 2480: PQ Calculation for Harmonics (Maximum Values) – Voltage Values

Register	Type of Information	Remark	Unit
2313	H_Vb/Vbc-7_MAX	7. Harmonic (maximum value), voltage value, b-N, bc	V/%
2315	H_Vb/Vbc-8_MAX	8. Harmonic (maximum value), voltage value, b-N, bc	V/%
2317	H_Vb/Vbc-9_MAX	9. Harmonic (maximum value), voltage value, b-N, bc	V/%
2323	H_Vb/Vbc-10_MAX	10. Harmonic (maximum value), voltage value, b-N, bc	V/%
2321	H_Vb/Vbc-11_MAX	11. Harmonic (maximum value), voltage value, b-N, bc	V/%
2323	H_Vb/Vbc-12_MAX	12. Harmonic (maximum value), voltage value, b-N, bc	V/%
2325	H_Vb/Vbc-13_MAX	13. Harmonic (maximum value), voltage value, b-N, bc	V/%
2327	H_Vb/Vbc-14_MAX	14. Harmonic (maximum value), voltage value, b-N, bc	V/%
2329	H_Vb/Vbc-15_MAX	15. Harmonic (maximum value), voltage value, b-N, bc	V/%
2331	H_Vb/Vbc-16_MAX	16. Harmonic (maximum value), voltage value, b-N, bc	V/%
2333	H_Vb/Vbc-17_MAX	17. Harmonic (maximum value), voltage value, b-N, bc	V/%
2335	H_Vb/Vbc-18_MAX	18. Harmonic (maximum value), voltage value, b-N, bc	V/%
2337	H_Vb/Vbc-19_MAX	19. Harmonic (maximum value), voltage value, b-N, bc	V/%
2339	H_Vb/Vbc-20_MAX	20. Harmonic (maximum value), voltage value, b-N, bc	V/%
2341	H_Vb/Vbc-21_MAX	21. Harmonic (maximum value), voltage value, b-N, bc	V/%
2343	H_Vb/Vbc-22_MAX	22. Harmonic (maximum value), voltage value, b-N, bc	V/%
2345	H_Vb/Vbc-23_MAX	23. Harmonic (maximum value), voltage value, b-N, bc	V/%
2347	H_Vb/Vbc-24_MAX	24. Harmonic (maximum value), voltage value, b-N, bc	V/%
2349	H_Vb/Vbc-25_MAX	25. Harmonic (maximum value), voltage value, b-N, bc	V/%
2351	H_Vb/Vbc-26_MAX	26. Harmonic (maximum value), voltage value, b-N, bc	V/%
2353	H_Vb/Vbc-27_MAX	27. Harmonic (maximum value), voltage value, b-N, bc	V/%
2355	H_Vb/Vbc-28_MAX	28. Harmonic (maximum value), voltage value, b-N, bc	V/%
2357	H_Vb/Vbc-29_MAX	29. Harmonic (maximum value), voltage value, b-N, bc	V/%
2359	H_Vb/Vbc-30_MAX	30. Harmonic (maximum value), voltage value, b-N, bc	V/%
2361	H_Vb/Vbc-31_MAX	31. Harmonic (maximum value), voltage value, b-N, bc	V/%
2363	H_Vb/Vbc-32_MAX	32. Harmonic (maximum value), voltage value, b-N, bc	V/%

Table 1-26 Registers 2201 to 2480: PQ Calculation for Harmonics (Maximum Values) – Voltage Values

Register	Type of Information	Remark	Unit
2365	H_Vb/Vbc-33_MAX	33. Harmonic (maximum value), voltage value, b-N, bc	V/%
2367	H_Vb/Vbc-34_MAX	34. Harmonic (maximum value), voltage value, b-N, bc	V/%
2369	H_Vb/Vbc-35_MAX	35. Harmonic (maximum value), voltage value, b-N, bc	V/%
2371	H_Vb/Vbc-36_MAX	36. Harmonic (maximum value), voltage value, b-N, bc	V/%
2373	H_Vb/Vbc-37_MAX	37. Harmonic (maximum value), voltage value, b-N, bc	V/%
2375	H_Vb/Vbc-38_MAX	38. Harmonic (maximum value), voltage value, b-N, bc	V/%
2377	H_Vb/Vbc-39_MAX	39. Harmonic (maximum value), voltage value, b-N, bc	V/%
2379	H_Vb/Vbc-40_MAX	40. Harmonic (maximum value), voltage value, b-N, bc	V/%
2401	H_Vc/Vca-1_MAX	1. Harmonic (maximum value), voltage value, c-N, ca (Basic wave)	V
2403	H_Vc/Vca-2_MAX	2. Harmonic (maximum value), voltage value, c-N, ca	V/%
2405	H_Vc/Vca-3_MAX	3. Harmonic (maximum value), voltage value, c-N, ca	V/%
2407	H_Vc/Vca-4_MAX	4. Harmonic (maximum value), voltage value, c-N, ca	V/%
2409	H_Vc/Vca-5_MAX	5. Harmonic (maximum value), voltage value, c-N, ca	V/%
2411	H_Vc/Vca-6_MAX	6. Harmonic (maximum value), voltage value, c-N, ca	V/%
2413	H_Vc/Vca-7_MAX	7. Harmonic (maximum value), voltage value, c-N, ca	V/%
2415	H_Vc/Vca-8_MAX	8. Harmonic (maximum value), voltage value, c-N, ca	V/%
2417	H_Vc/Vca-9_MAX	9. Harmonic (maximum value), voltage value, c-N, ca	V/%
2419	H_Vc/Vca-10_MAX	10. Harmonic (maximum value), voltage value, c-N, ca	V/%
2421	H_Vc/Vca-11_MAX	11. Harmonic (maximum value), voltage value, c-N, ca	V/%
2423	H_Vc/Vca-12_MAX	12. Harmonic (maximum value), voltage value, c-N, ca	V/%
2425	H_Vc/Vca-13_MAX	13. Harmonic (maximum value), voltage value, c-N, ca	V/%
2427	H_Vc/Vca-14_MAX	14. Harmonic (maximum value), voltage value, c-N, ca	V/%
2429	H_Vc/Vca-15_MAX	15. Harmonic (maximum value), voltage value, c-N, ca	V/%
2431	H_Vc/Vca-16_MAX	16. Harmonic (maximum value), voltage value, c-N, ca	V/%
2433	H_Vc/Vca-17_MAX	17. Harmonic (maximum value), voltage value, c-N, ca	V/%

Table 1-26 Registers 2201 to 2480: PQ Calculation for Harmonics (Maximum Values) – Voltage Values

Register	Type of Information	Remark	Unit
2435	H_Vc/Vca-18_MAX	18. Harmonic (maximum value), voltage value, c-N, ca	V/%
2437	H_Vc/Vca-19_MAX	19. Harmonic (maximum value), voltage value, c-N, ca	V/%
2439	H_Vc/Vca-20_MAX	20. Harmonic (maximum value), voltage value, c-N, ca	V/%
2441	H_Vc/Vca-21_MAX	21. Harmonic (maximum value), voltage value, c-N, ca	V/%
2443	H_Vc/Vca-22_MAX	22. Harmonic (maximum value), voltage value, c-N, ca	V/%
2445	H_Vc/Vca-23_MAX	23. Harmonic (maximum value), voltage value, c-N, ca	V/%
2447	H_Vc/Vca-24_MAX	24. Harmonic (maximum value), voltage value, c-N, ca	V/%
2449	H_Vc/Vca-25_MAX	25. Harmonic (maximum value), voltage value, c-N, ca	V/%
2451	H_Vc/Vca-26_MAX	26. Harmonic (maximum value), voltage value, c-N, ca	V/%
2453	H_Vc/Vca-27_MAX	27. Harmonic (maximum value), voltage value, c-N, ca	V/%
2455	H_Vc/Vca-28_MAX	28. Harmonic (maximum value), voltage value, c-N, ca	V/%
2457	H_Vc/Vca-29_MAX	29. Harmonic (maximum value), voltage value, c-N, ca	V/%
2459	H_Vc/Vca-30_MAX	30. Harmonic (maximum value), voltage value, c-N, ca	V/%
2461	H_Vc/Vca-31_MAX	31. Harmonic (maximum value), voltage value, c-N, ca	V/%
2463	H_Vc/Vca-32_MAX	32. Harmonic (maximum value), voltage value, c-N, ca	V/%
2465	H_Vc/Vca-33_MAX	33. Harmonic (maximum value), voltage value, c-N, ca	V/%
2467	H_Vc/Vca-34_MAX	34. Harmonic (maximum value), voltage value, c-N, ca	V/%
2469	H_Vc/Vca-35_MAX	35. Harmonic (maximum value), voltage value, c-N, ca	V/%
2471	H_Vc/Vca-36_MAX	36. Harmonic (maximum value), voltage value, c-N, ca	V/%
2473	H_Vc/Vca-37_MAX	37. Harmonic (maximum value), voltage value, c-N, ca	V/%
2475	H_Vc/Vca-38_MAX	38. Harmonic (maximum value), voltage value, c-N, ca	V/%
2477	H_Vc/Vca-39_MAX	39. Harmonic (maximum value), voltage value, c-N, ca	V/%
2479	H_Vc/Vca-40_MAX	40. Harmonic (maximum value), voltage value, c-N, ca	V/%

1.2.6.21 Registers 2601 to 2880: PQ Calculation for Average Harmonic – Current Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

The data are calculated within the parameterized time (for example 30 s, 1 min etc.).

Data type: Measured value

Table 1-27 Registers 2601 to 2880: PQ Calculation for Harmonics (Average Values) – Current Values

Register	Type of Information	Remark	Unit
2601	H_la-1_AVG	1. Harmonic (average value), current value, a-N (Basic wave)	A
2603	H_la-2_AVG	2. Harmonic (average value), current value, a-N	A
2605	H_la-3_AVG	3. Harmonic (average value), current value, a-N	A
2607	H_la-4_AVG	4. Harmonic (average value), current value, a-N	A
2609	H_la-5_AVG	5. Harmonic (average value), current value, a-N	A
2611	H_la-6_AVG	6. Harmonic (average value), current value, a-N	A
2613	H_la-7_AVG	7. Harmonic (average value), current value, a-N	A
2615	H_la-8_AVG	8. Harmonic (average value), current value, a-N	A
2617	H_la-9_AVG	9. Harmonic (average value), current value, a-N	A
2619	H_la-10_AVG	10. Harmonic (average value), current value, a-N	A
2621	H_la-11_AVG	11. Harmonic (average value), current value, a-N	A
2623	H_la-12_AVG	12. Harmonic (average value), current value, a-N	A
2625	H_la-13_AVG	13. Harmonic (average value), current value, a-N	A
2627	H_la-14_AVG	14. Harmonic (average value), current value, a-N	A
2629	H_la-15_AVG	15. Harmonic (average value), current value, a-N	A
2631	H_la-16_AVG	16. Harmonic (average value), current value, a-N	A
2633	H_la-17_AVG	17. Harmonic (average value), current value, a-N	A
2635	H_la-18_AVG	18. Harmonic (average value), current value, a-N	A
2637	H_la-19_AVG	19. Harmonic (average value), current value, a-N	A
2639	H_la-20_AVG	20. Harmonic (average value), current value, a-N	A
2641	H_la-21_AVG	21. Harmonic (average value), current value, a-N	A

Table 1-27 Registers 2601 to 2880: PQ Calculation for Harmonics (Average Values) – Current Values

Register	Type of Information	Remark	Unit
2643	H_Ia-22_AVG	22. Harmonic (average value), current value, a-N	A
2645	H_Ia-23_AVG	23. Harmonic (average value), current value, a-N	A
2647	H_Ia-24_AVG	24. Harmonic (average value), current value, a-N	A
2649	H_Ia-25_AVG	25. Harmonic (average value), current value, a-N	A
2651	H_Ia-26_AVG	26. Harmonic (average value), current value, a-N	A
2653	H_Ia-27_AVG	27. Harmonic (average value), current value, a-N	A
2655	H_Ia-28_AVG	28. Harmonic (average value), current value, a-N	A
2657	H_Ia-29_AVG	29. Harmonic (average value), current value, a-N	A
2659	H_Ia-30_AVG	30. Harmonic (average value), current value, a-N	A
2661	H_Ia-31_AVG	31. Harmonic (average value), current value, a-N	A
2663	H_Ia-32_AVG	32. Harmonic (average value), current value, a-N	A
2665	H_Ia-33_AVG	33. Harmonic (average value), current value, a-N	A
2667	H_Ia-34_AVG	34. Harmonic (average value), current value, a-N	A
2669	H_Ia-35_AVG	35. Harmonic (average value), current value, a-N	A
2671	H_Ia-36_AVG	36. Harmonic (average value), current value, a-N	A
2673	H_Ia-37_AVG	37. Harmonic (average value), current value, a-N	A
2675	H_Ia-38_AVG	38. Harmonic (average value), current value, a-N	A
2677	H_Ia-39_AVG	39. Harmonic (average value), current value, a-N	A
2679	H_Ia-40_AVG	40. Harmonic (average value), current value, a-N	A
2701	H_Ib-1_AVG	1. Harmonic (average value), current value, b-N (Basic wave)	A
2703	H_Ib-2_AVG	2. Harmonic (average value), current value, b-N	A
2705	H_Ib-3_AVG	3. Harmonic (average value), current value, b-N	A
2707	H_Ib-4_AVG	4. Harmonic (average value), current value, b-N	A
2709	H_Ib-5_AVG	5. Harmonic (average value), current value, b-N	A
2711	H_Ib-6_AVG	6. Harmonic (average value), current value, b-N	A

Table 1-27 Registers 2601 to 2880: PQ Calculation for Harmonics (Average Values) – Current Values

Register	Type of Information	Remark	Unit
2713	H_lb-7_AVG	7. Harmonic (average value), current value, b-N	A
2715	H_lb-8_AVG	8. Harmonic (average value), current value, b-N	A
2717	H_lb-9_AVG	9. Harmonic (average value), current value, b-N	A
2719	H_lb-10_AVG	10. Harmonic (average value), current value, b-N	A
2721	H_lb-11_AVG	11. Harmonic (average value), current value, b-N	A
2723	H_lb-12_AVG	12. Harmonic (average value), current value, b-N	A
2725	H_lb-13_AVG	13. Harmonic (average value), current value, b-N	A
2727	H_lb-14_AVG	14. Harmonic (average value), current value, b-N	A
2729	H_lb-15_AVG	15. Harmonic (average value), current value, b-N	A
2731	H_lb-16_AVG	16. Harmonic (average value), current value, b-N	A
2733	H_lb-17_AVG	17. Harmonic (average value), current value, b-N	A
2735	H_lb-18_AVG	18. Harmonic (average value), current value, b-N	A
2737	H_lb-19_AVG	19. Harmonic (average value), current value, b-N	A
2739	H_lb-20_AVG	20. Harmonic (average value), current value, b-N	A
2741	H_lb-21_AVG	21. Harmonic (average value), current value, b-N	A
2743	H_lb-22_AVG	22. Harmonic (average value), current value, b-N	A
2745	H_lb-23_AVG	23. Harmonic (average value), current value, b-N	A
2747	H_lb-24_AVG	24. Harmonic (average value), current value, b-N	A
2749	H_lb-25_AVG	25. Harmonic (average value), current value, b-N	A
2751	H_lb-26_AVG	26. Harmonic (average value), current value, b-N	A
2753	H_lb-27_AVG	27. Harmonic (average value), current value, b-N	A
2755	H_lb-28_AVG	28. Harmonic (average value), current value, b-N	A
2757	H_lb-29_AVG	29. Harmonic (average value), current value, b-N	A
2759	H_lb-30_AVG	30. Harmonic (average value), current value, b-N	A
2761	H_lb-31_AVG	31. Harmonic (average value), current value, b-N	A
2763	H_lb-32_AVG	32. Harmonic (average value), current value, b-N	A

Table 1-27 Registers 2601 to 2880: PQ Calculation for Harmonics (Average Values) – Current Values

Register	Type of Information	Remark	Unit
2765	H_Ib-33_AVG	33. Harmonic (average value), current value, b-N	A
2767	H_Ib-34_AVG	34. Harmonic (average value), current value, b-N	A
2769	H_Ib-35_AVG	35. Harmonic (average value), current value, b-N	A
2771	H_Ib-36_AVG	36. Harmonic (average value), current value, b-N	A
2773	H_Ib-37_AVG	37. Harmonic (average value), current value, b-N	A
2775	H_Ib-38_AVG	38. Harmonic (average value), current value, b-N	A
2777	H_Ib-39_AVG	39. Harmonic (average value), current value, b-N	A
2779	H_Ib-40_AVG	40. Harmonic (average value), current value, b-N	A
2801	H_Ic-1_AVG	1. Harmonic (average value), current value, c-N (Basic wave)	A
2803	H_Ic-2_AVG	2. Harmonic (average value), current value, c-N	A
2805	H_Ic-3_AVG	3. Harmonic (average value), current value, c-N	A
2807	H_Ic-4_AVG	4. Harmonic (average value), current value, c-N	A
2809	H_Ic-5_AVG	5. Harmonic (average value), current value, c-N	A
2811	H_Ic-6_AVG	6. Harmonic (average value), current value, c-N	A
2813	H_Ic-7_AVG	7. Harmonic (average value), current value, c-N	A
2815	H_Ic-8_AVG	8. Harmonic (average value), current value, c-N	A
2817	H_Ic-9_AVG	9. Harmonic (average value), current value, c-N	A
2819	H_Ic-10_AVG	10. Harmonic (average value), current value, c-N	A
2821	H_Ic-11_AVG	11. Harmonic (average value), current value, c-N	A
2823	H_Ic-12_AVG	12. Harmonic (average value), current value, c-N	A
2825	H_Ic-13_AVG	13. Harmonic (average value), current value, c-N	A
2827	H_Ic-14_AVG	14. Harmonic (average value), current value, c-N	A
2829	H_Ic-15_AVG	15. Harmonic (average value), current value, c-N	A
2831	H_Ic-16_AVG	16. Harmonic (average value), current value, c-N	A
2833	H_Ic-17_AVG	17. Harmonic (average value), current value, c-N	A

Table 1-27 Registers 2601 to 2880: PQ Calculation for Harmonics (Average Values) – Current Values

Register	Type of Information	Remark	Unit
2835	H_lc-18_AVG	18. Harmonic (average value), current value, c-N	A
2837	H_lc-19_AVG	19. Harmonic (average value), current value, c-N	A
2839	H_lc-20_AVG	20. Harmonic (average value), current value, c-N	A
2841	H_lc-21_AVG	21. Harmonic (average value), current value, c-N	A
2843	H_lc-22_AVG	22. Harmonic (average value), current value, c-N	A
2845	H_lc-23_AVG	23. Harmonic (average value), current value, c-N	A
2847	H_lc-24_AVG	24. Harmonic (average value), current value, c-N	A
2849	H_lc-25_AVG	25. Harmonic (average value), current value, c-N	A
2851	H_lc-26_AVG	26. Harmonic (average value), current value, c-N	A
2853	H_lc-27_AVG	27. Harmonic (average value), current value, c-N	A
2855	H_lc-28_AVG	28. Harmonic (average value), current value, c-N	A
2857	H_lc-29_AVG	29. Harmonic (average value), current value, c-N	A
2859	H_lc-30_AVG	30. Harmonic (average value), current value, c-N	A
2861	H_lc-31_AVG	31. Harmonic (average value), current value, c-N	A
2863	H_lc-32_AVG	32. Harmonic (average value), current value, c-N	A
2865	H_lc-33_AVG	33. Harmonic (average value), current value, c-N	A
2867	H_lc-34_AVG	34. Harmonic (average value), current value, c-N	A
2869	H_lc-35_AVG	35. Harmonic (average value), current value, c-N	A
2871	H_lc-36_AVG	36. Harmonic (average value), current value, c-N	A
2873	H_lc-37_AVG	37. Harmonic (average value), current value, c-N	A
2875	H_lc-38_AVG	38. Harmonic (average value), current value, c-N	A
2877	H_lc-39_AVG	39. Harmonic (average value), current value, c-N	A
2879	H_lc-40_AVG	40. Harmonic (average value), current value, c-N	A

1.2.6.22 Registers 3001 to 3280: PQ Calculation for Maximum Harmonic – Current Values

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

The data are calculated within the parameterized time (for example 30 s, 1 min etc.).

Data type: Measured value

Table 1-28 Registers 3001 to 3280: PQ Calculation for Harmonics (Maximum Values) – Current Values

Register	Type of Information	Remark	Unit
3001	H_la-1_MAX	1. Harmonic (maximum value), current value, a-N (Basic wave)	A
3003	H_la-2_MAX	2. Harmonic (maximum value), current value, a-N	A
3005	H_la-3_MAX	3. Harmonic (maximum value), current value, a-N	A
3007	H_la-4_MAX	4. Harmonic (maximum value), current value, a-N	A
3009	H_la-5_MAX	5. Harmonic (maximum value), current value, a-N	A
3011	H_la-6_MAX	6. Harmonic (maximum value), current value, a-N	A
3013	H_la-7_MAX	7. Harmonic (maximum value), current value, a-N	A
3015	H_la-8_MAX	8. Harmonic (maximum value), current value, a-N	A
3017	H_la-9_MAX	9. Harmonic (maximum value), current value, a-N	A
3019	H_la-10_MAX	10. Harmonic (maximum value), current value, a-N	A
3021	H_la-11_MAX	11. Harmonic (maximum value), current value, a-N	A
3023	H_la-12_MAX	12. Harmonic (maximum value), current value, a-N	A
3025	H_la-13_MAX	13. Harmonic (maximum value), current value, a-N	A
3027	H_la-14_MAX	14. Harmonic (maximum value), current value, a-N	A
3029	H_la-15_MAX	15. Harmonic (maximum value), current value, a-N	A
3031	H_la-16_MAX	16. Harmonic (maximum value), current value, a-N	A
3033	H_la-17_MAX	17. Harmonic (maximum value), current value, a-N	A
3035	H_la-18_MAX	18. Harmonic (maximum value), current value, a-N	A
3037	H_la-19_MAX	19. Harmonic (maximum value), current value, a-N	A
3039	H_la-20_MAX	20. Harmonic (maximum value), current value, a-N	A
3041	H_la-21_MAX	21. Harmonic (maximum value), current value, a-N	A

Table 1-28 Registers 3001 to 3280: PQ Calculation for Harmonics (Maximum Values) – Current Values

Register	Type of Information	Remark	Unit
3043	H_la-22_MAX	22. Harmonic (maximum value), current value, a-N	A
3045	H_la-23_MAX	23. Harmonic (maximum value), current value, a-N	A
3047	H_la-24_MAX	24. Harmonic (maximum value), current value, a-N	A
3049	H_la-25_MAX	25. Harmonic (maximum value), current value, a-N	A
3051	H_la-26_MAX	26. Harmonic (maximum value), current value, a-N	A
3053	H_la-27_MAX	27. Harmonic (maximum value), current value, a-N	A
3055	H_la-28_MAX	28. Harmonic (maximum value), current value, a-N	A
3057	H_la-29_MAX	29. Harmonic (maximum value), current value, a-N	A
3059	H_la-30_MAX	30. Harmonic (maximum value), current value, a-N	A
3061	H_la-31_MAX	31. Harmonic (maximum value), current value, a-N	A
3063	H_la-32_MAX	32. Harmonic (maximum value), current value, a-N	A
3065	H_la-33_MAX	33. Harmonic (maximum value), current value, a-N	A
3067	H_la-34_MAX	34. Harmonic (maximum value), current value, a-N	A
3069	H_la-35_MAX	35. Harmonic (maximum value), current value, a-N	A
3071	H_la-36_MAX	36. Harmonic (maximum value), current value, a-N	A
3073	H_la-37_MAX	37. Harmonic (maximum value), current value, a-N	A
3075	H_la-38_MAX	38. Harmonic (maximum value), current value, a-N	A
3077	H_la-39_MAX	39. Harmonic (maximum value), current value, a-N	A
3079	H_la-40_MAX	40. Harmonic (maximum value), current value, a-N	A
3101	H_lb-1_MAX	1. Harmonic (maximum value), current value, b-N (Basic wave)	A
3103	H_lb-2_MAX	2. Harmonic (maximum value), current value, b-N	A
3105	H_lb-3_MAX	3. Harmonic (maximum value), current value, b-N	A
3107	H_lb-4_MAX	4. Harmonic (maximum value), current value, b-N	A
3109	H_lb-5_MAX	5. Harmonic (maximum value), current value, b-N	A
3111	H_lb-6_MAX	6. Harmonic (maximum value), current value, b-N	A

Table 1-28 Registers 3001 to 3280: PQ Calculation for Harmonics (Maximum Values) – Current Values

Register	Type of Information	Remark	Unit
3113	H_Ib-7_MAX	7. Harmonic (maximum value), current value, b-N	A
3115	H_Ib-8_MAX	8. Harmonic (maximum value), current value, b-N	A
3117	H_Ib-9_MAX	9. Harmonic (maximum value), current value, b-N	A
3119	H_Ib-10_MAX	10. Harmonic (maximum value), current value, b-N	A
3121	H_Ib-11_MAX	11. Harmonic (maximum value), current value, b-N	A
3123	H_Ib-12_MAX	12. Harmonic (maximum value), current value, b-N	A
3125	H_Ib-13_MAX	13. Harmonic (maximum value), current value, b-N	A
3127	H_Ib-14_MAX	14. Harmonic (maximum value), current value, b-N	A
3129	H_Ib-15_MAX	15. Harmonic (maximum value), current value, b-N	A
3131	H_Ib-16_MAX	16. Harmonic (maximum value), current value, b-N	A
3133	H_Ib-17_MAX	17. Harmonic (maximum value), current value, b-N	A
3135	H_Ib-18_MAX	18. Harmonic (maximum value), current value, b-N	A
3137	H_Ib-19_MAX	19. Harmonic (maximum value), current value, b-N	A
3139	H_Ib-20_MAX	20. Harmonic (maximum value), current value, b-N	A
3141	H_Ib-21_MAX	21. Harmonic (maximum value), current value, b-N	A
3143	H_Ib-22_MAX	22. Harmonic (maximum value), current value, b-N	A
3145	H_Ib-23_MAX	23. Harmonic (maximum value), current value, b-N	A
3147	H_Ib-24_MAX	24. Harmonic (maximum value), current value, b-N	A
3149	H_Ib-25_MAX	25. Harmonic (maximum value), current value, b-N	A
3151	H_Ib-26_MAX	26. Harmonic (maximum value), current value, b-N	A
3153	H_Ib-27_MAX	27. Harmonic (maximum value), current value, b-N	A
3155	H_Ib-28_MAX	28. Harmonic (maximum value), current value, b-N	A
3157	H_Ib-29_MAX	29. Harmonic (maximum value), current value, b-N	A
3159	H_Ib-30_MAX	30. Harmonic (maximum value), current value, b-N	A
3161	H_Ib-31_MAX	31. Harmonic (maximum value), current value, b-N	A
3163	H_Ib-32_MAX	32. Harmonic (maximum value), current value, b-N	A

Table 1-28 Registers 3001 to 3280: PQ Calculation for Harmonics (Maximum Values) – Current Values

Register	Type of Information	Remark	Unit
3165	H_lb-33_MAX	33. Harmonic (maximum value), current value, b-N	A
3167	H_lb-34_MAX	34. Harmonic (maximum value), current value, b-N	A
3169	H_lb-35_MAX	35. Harmonic (maximum value), current value, b-N	A
3171	H_lb-36_MAX	36. Harmonic (maximum value), current value, b-N	A
3173	H_lb-37_MAX	37. Harmonic (maximum value), current value, b-N	A
3175	H_lb-38_MAX	38. Harmonic (maximum value), current value, b-N	A
3177	H_lb-39_MAX	39. Harmonic (maximum value), current value, b-N	A
3179	H_lb-40_MAX	40. Harmonic (maximum value), current value, b-N	A
3201	H_lc-1_MAX	1. Harmonic (maximum value), current value, c-N (Basic wave)	A
3203	H_lc-2_MAX	2. Harmonic (maximum value), current value, c-N	A
3205	H_lc-3_MAX	3. Harmonic (maximum value), current value, c-N	A
3207	H_lc-4_MAX	4. Harmonic (maximum value), current value, c-N	A
3209	H_lc-5_MAX	5. Harmonic (maximum value), current value, c-N	A
3211	H_lc-6_MAX	6. Harmonic (maximum value), current value, c-N	A
3213	H_lc-7_MAX	7. Harmonic (maximum value), current value, c-N	A
3215	H_lc-8_MAX	8. Harmonic (maximum value), current value, c-N	A
3217	H_lc-9_MAX	9. Harmonic (maximum value), current value, c-N	A
3219	H_lc-10_MAX	10. Harmonic (maximum value), current value, c-N	A
3221	H_lc-11_MAX	11. Harmonic (maximum value), current value, c-N	A
3223	H_lc-12_MAX	12. Harmonic (maximum value), current value, c-N	A
3225	H_lc-13_MAX	13. Harmonic (maximum value), current value, c-N	A
3227	H_lc-14_MAX	14. Harmonic (maximum value), current value, c-N	A
3229	H_lc-15_MAX	15. Harmonic (maximum value), current value, c-N	A
3231	H_lc-16_MAX	16. Harmonic (maximum value), current value, c-N	A
3233	H_lc-17_MAX	17. Harmonic (maximum value), current value, c-N	A

Table 1-28 Registers 3001 to 3280: PQ Calculation for Harmonics (Maximum Values) – Current Values

Register	Type of Information	Remark	Unit
3235	H_Ic-18_MAX	18. Harmonic (maximum value), current value, c-N	A
3237	H_Ic-19_MAX	19. Harmonic (maximum value), current value, c-N	A
3239	H_Ic-20_MAX	20. Harmonic (maximum value), current value, c-N	A
3241	H_Ic-21_MAX	21. Harmonic (maximum value), current value, c-N	A
3243	H_Ic-22_MAX	22. Harmonic (maximum value), current value, c-N	A
3245	H_Ic-23_MAX	23. Harmonic (maximum value), current value, c-N	A
3247	H_Ic-24_MAX	24. Harmonic (maximum value), current value, c-N	A
3249	H_Ic-25_MAX	25. Harmonic (maximum value), current value, c-N	A
3251	H_Ic-26_MAX	26. Harmonic (maximum value), current value, c-N	A
3253	H_Ic-27_MAX	27. Harmonic (maximum value), current value, c-N	A
3255	H_Ic-28_MAX	28. Harmonic (maximum value), current value, c-N	A
3257	H_Ic-29_MAX	29. Harmonic (maximum value), current value, c-N	A
3259	H_Ic-30_MAX	30. Harmonic (maximum value), current value, c-N	A
3261	H_Ic-31_MAX	31. Harmonic (maximum value), current value, c-N	A
3263	H_Ic-32_MAX	32. Harmonic (maximum value), current value, c-N	A
3265	H_Ic-33_MAX	33. Harmonic (maximum value), current value, c-N	A
3267	H_Ic-34_MAX	34. Harmonic (maximum value), current value, c-N	A
3269	H_Ic-35_MAX	35. Harmonic (maximum value), current value, c-N	A
3271	H_Ic-36_MAX	36. Harmonic (maximum value), current value, c-N	A
3273	H_Ic-37_MAX	37. Harmonic (maximum value), current value, c-N	A
3275	H_Ic-38_MAX	38. Harmonic (maximum value), current value, c-N	A
3277	H_Ic-39_MAX	39. Harmonic (maximum value), current value, c-N	A
3279	H_Ic-40_MAX	40. Harmonic (maximum value), current value, c-N	A

1.2.6.23 Register 5001 to 5099: Latest 10 Dips

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: Measured value

Table 1-29 Register 5001 to 5099: Latest 10 Dips

Register	Type of Information	Unit	Remark
5001	Milliseconds		Start time of dip Data format see chapter 1.2.5.2
5002	Hours/minutes		
5003	Month/day		
5004	Time status/year		
5005 to 5006	Voltage dip 1	V	Minimum voltage value during dip 1
5007 to 5008	Voltage dip 1 time duration	s	Dip 1 time duration
5009	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5011	Milliseconds		Start time of dip Data format see chapter 1.2.5.2
5012	Hours/minutes		
5013	Month/day		
5014	Time status/year		
5015 to 5016	Voltage dip 2	V	Minimum voltage value during dip 2
5017 to 5018	Voltage dip 2 time duration	s	Dip 2 time duration
5019	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5021	Milliseconds		Start time of dip Data format see chapter 1.2.5.2
5022	Hours/minutes		
5023	Month/day		
5024	Time status/year		
5025 to 5026	Voltage dip 3	V	Minimum voltage value during dip 3

Table 1-29 Register 5001 to 5099: Latest 10 Dips (cont.)

Register	Type of Information	Unit	Remark
5027 to 5028	Voltage dip 3 time duration	s	Dip 3 time duration
5029	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5031	Milliseconds	Start time of dip Data format see chapter 1.2.5.2	
5032	Hours/minutes		
5033	Month/day		
5034	Time status/year		
5035 to 5036	Voltage dip 4	V	Minimum voltage value during dip 4
5037 to 5038	Voltage dip 4 time duration	s	Dip 4 time duration
5039	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5041	Milliseconds	Start time of dip Data format see chapter 1.2.5.2	
5042	Hours/minutes		
5043	Month/day		
5044	Time status/year		
5045 to 5046	Voltage dip 5	V	Minimum voltage value during dip 5
5047 to 5048	Voltage dip 5 time duration	s	Dip 5 time duration
5049	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5051	Milliseconds	Start time of dip Data format see chapter 1.2.5.2	
5052	Hours/minutes		
5053	Month/day		
5054	Time status/year		

Table 1-29 Register 5001 to 5099: Latest 10 Dips (cont.)

Register	Type of Information	Unit	Remark
5055 to 5056	Voltage dip 6	V	Minimum voltage value during dip 6
5057 to 5058	Voltage dip 6 time duration	s	Dip 6 time duration
5059	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5061	Milliseconds	Start time of dip Data format see chapter 1.2.5.2	
5062	Hours/minutes		
5063	Month/day		
5064	Time status/year		
5065 to 5066	Voltage dip 7	V	Minimum voltage value during dip 7
5067 to 5068	Voltage dip 7 time duration	s	Dip 7 time duration
5069	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5071	Milliseconds	Start time of dip Data format see chapter 1.2.5.2	
5072	Hours/minutes		
5073	Month/day		
5074	Time status/year		
5075 to 5076	Voltage dip 8	V	Minimum voltage value during dip 8
5077 to 5078	Voltage dip 8 time duration	s	Dip 8 time duration
5079	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced

Table 1-29 Register 5001 to 5099: Latest 10 Dips (cont.)

Register	Type of Information	Unit	Remark
5081	Milliseconds		Start time of dip Data format see chapter 1.2.5.2
5082	Hours/minutes		
5083	Month/day		
5084	Time status/year		
5085 to 5086	Voltage dip 9	V	Minimum voltage value during dip 9
5087 to 5088	Voltage dip 9 time duration	s	Dip 9 time duration
5089	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5091	Milliseconds		Start time of dip Data format see chapter 1.2.5.2
5092	Hours/minutes		
5093	Month/day		
5094	Time status/year		
5095 to 5096	Voltage dip 10	V	Minimum voltage value during dip 10
5097 to 5098	Voltage dip 10 time duration	s	Dip 10 time duration
5099	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced

1.2.6.24 Register 5201 to 5299: Latest 10 Swells

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: Measured value

Table 1-30 Register 5201 to 5299: Latest 10 Swells

Register	Type of Information	Unit	Remark
5201	Milliseconds		Start time of swell Data format see chapter 1.2.5.2
5202	Hours/minutes		
5203	Month/day		
5204	Time status/year		
5205 to 5206	Voltage swell 1	V	Maximum voltage value during swell 1
5207 to 5208	Voltage swell 1 time duration	s	Swell 1 time duration
5209	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5211	Milliseconds		Start time of swell Data format see chapter 1.2.5.2
5212	Hours/minutes		
5213	Month/day		
5214	Time status/year		
5215 to 5216	Voltage swell 2	V	Maximum voltage value during swell 2
5217 to 5218	Voltage swell 2 time duration	s	Swell 2 time duration
5219	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5221	Milliseconds		Start time of swell Data format see chapter 1.2.5.2
5222	Hours/minutes		
5223	Month/day		
5224	Time status/year		
5225 to 5226	Voltage swell 3	V	Maximum voltage value during swell 3

Table 1-30 Register 5201 to 5299: Latest 10 Swells (cont.)

Register	Type of Information	Unit	Remark
5227 to 5228	Voltage swell 3 time duration	s	Swell 3 time duration
5229	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5231	Milliseconds	Start time of swell Data format see chapter 1.2.5.2	
5232	Hours/minutes		
5233	Month/day		
5234	Time status/year		
5235 to 5236	Voltage swell 4	V	Maximum voltage value during swell 4
5237 to 5238	Voltage swell 4 time duration	s	Swell 4 time duration
5239	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5241	Milliseconds	Start time of swell Data format see chapter 1.2.5.2	
5242	Hours/minutes		
5243	Month/day		
5244	Time status/year		
5245 to 5246	Voltage swell 5	V	Maximum voltage value during swell 5
5247 to 5248	Voltage swell 5 time duration	s	Swell 5 time duration
5249	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5251	Milliseconds	Start time of swell Data format see chapter 1.2.5.2	
5252	Hours/minutes		
5253	Month/day		
5254	Time status/year		

Table 1-30 Register 5201 to 5299: Latest 10 Swells (cont.)

Register	Type of Information	Unit	Remark
5255 to 5256	Voltage swell 6	V	Maximum voltage value during swell 6
5257 to 5258	Voltage swell 6 time duration	s	Swell 6 time duration
5259	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5261	Milliseconds	Start time of swell Data format see chapter 1.2.5.2	
5262	Hours/minutes		
5263	Month/day		
5264	Time status/year		
5265 to 5266	Voltage swell 7	V	Maximum voltage value during swell 7
5267 to 5268	Voltage swell 7 time duration	s	Swell 7 time duration
5269	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5271	Milliseconds	Start time of swell Data format see chapter 1.2.5.2	
5272	Hours/minutes		
5273	Month/day		
5274	Time status/year		
5275 to 5276	Voltage swell 8	V	Maximum voltage value during swell 8
5277 to 5278	Voltage swell 8 time duration	s	Swell 8 time duration
5279	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced

Table 1-30 Register 5201 to 5299: Latest 10 Swells (cont.)

Register	Type of Information	Unit	Remark
5281	Milliseconds	Start time of swell	Data format see chapter 1.2.5.2
5282	Hours/minutes		
5283	Month/day		
5284	Time status/year		
5285 to 5286	Voltage swell 9	V	Maximum voltage value during swell 9
5287 to 5288	Voltage swell 9 time duration	s	Swell 9 time duration
5289	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5291	Milliseconds	Start time of swell	Data format see chapter 1.2.5.2
5292	Hours/minutes		
5293	Month/day		
5294	Time status/year		
5295 to 5296	Voltage swell 10	V	Maximum voltage value during swell 10
5297 to 5298	Voltage swell 10 time duration	s	Swell 10 time duration
5299	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced

1.2.6.25 Register 5401 to 5499: Latest 10 Voltage Interrupts

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

Data type: Measured value

Table 1-31 Register 5401 to 5499: Latest 10 Voltage Interrupts

Register	Type of Information	Unit	Remark
5401	Milliseconds		Start time of interrupt Data format see chapter 1.2.5.2
5402	Hours/minutes		
5403	Month/day		
5404	Time status/year		
5405 to 5406	Voltage interrupt 1	V	Minimum voltage value during interrupt 1
5407 to 5408	Voltage interrupt 1 time duration	s	Interrupt 1 time duration
5409	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5411	Milliseconds		Start time of interrupt Data format see chapter 1.2.5.2
5412	Hours/minutes		
5413	Month/day		
5414	Time status/year		
5415 to 5416	Voltage interrupt 2	V	Minimum voltage value during interrupt 2
5417 to 5418	Voltage interrupt 2 time duration	s	Interrupt 2 time duration
5419	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5421	Milliseconds		Start time of interrupt Data format see chapter 1.2.5.2
5422	Hours/minutes		
5423	Month/day		
5424	Time status/year		

Table 1-31 Register 5401 to 5499: Latest 10 Voltage Interrupts (cont.)

Register	Type of Information	Unit	Remark
5425 to 5426	Voltage interrupt 3	V	Minimum voltage value during interrupt 3
5427 to 5428	Voltage interrupt 3 time duration	s	Interrupt 3 time duration
5429	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5431	Milliseconds	Start time of interrupt Data format see chapter 1.2.5.2	
5432	Hours/minutes		
5433	Month/day		
5434	Time status/year		
5435 to 5436	Voltage interrupt 4	V	Minimum voltage value during interrupt 4
5437 to 5438	Voltage interrupt 4 time duration	s	Interrupt 4 time duration
5439	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5441	Milliseconds	Start time of interrupt Data format see chapter 1.2.5.2	
5442	Hours/minutes		
5443	Month/day		
5444	Time status/year		
5445 to 5446	Voltage interrupt 5	V	Minimum voltage value during interrupt 5
5447 to 5448	Voltage interrupt 5 time duration	s	Interrupt 5 time duration
5449	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced

Table 1-31 Register 5401 to 5499: Latest 10 Voltage Interrupts (cont.)

Register	Type of Information	Unit	Remark
5451	Milliseconds		Start time of interrupt Data format see chapter 1.2.5.2
5452	Hours/minutes		
5453	Month/day		
5454	Time status/year		
5455 to 5456	Voltage interrupt 6	V	Minimum voltage value during interrupt 6
5457 to 5458	Voltage interrupt 6 time duration	s	Interrupt 6 time duration
5459	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5461	Milliseconds		Start time of interrupt Data format see chapter 1.2.5.2
5462	Hours/minutes		
5463	Month/day		
5464	Time status/year		
5465 to 5466	Voltage interrupt 7	V	Minimum voltage value during interrupt 7
5467 to 5468	Voltage interrupt 7 time duration	s	Interrupt 7 time duration
5469	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5471	Milliseconds		Start time of interrupt Data format see chapter 1.2.5.2
5472	Hours/minutes		
5473	Month/day		
5474	Time status/year		
5475 to 5476	Voltage interrupt 8	V	Minimum voltage value during interrupt 8
5477 to 5478	Voltage interrupt 8 time duration	s	Interrupt 8 time duration

Table 1-31 Register 5401 to 5499: Latest 10 Voltage Interrupts (cont.)

Register	Type of Information	Unit	Remark
5479	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5481	Milliseconds	Start time of interrupt Data format see chapter 1.2.5.2	
5482	Hours/minutes		
5483	Month/day		
5484	Time status/year		
5485 to 5486	Voltage interrupt 9	V	Minimum voltage value during interrupt 9
5487 to 5488	Voltage interrupt 9 time duration	s	Interrupt 9 time duration
5489	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced
5491	Milliseconds	Start time of interrupt Data format see chapter 1.2.5.2	
5492	Hours/minutes		
5493	Month/day		
5494	Time status/year		
5495 to 5496	Voltage interrupt 10	V	Minimum voltage value during interrupt 10
5497 to 5498	Voltage interrupt 10 time duration	s	Interrupt 10 time duration
5499	Influenced phase	-	Related phases bit 0: Va, bit 1: Vb, bit 2: Vc, bit 3: Vab, bit 4: Vbc, bit 5: Vca if any bit =1 means corresponding phase is influenced

1.2.6.26 Register 6001 to 6004: Number of PQ Events

These registers are write-protected. A write attempt will be rejected with exception code 03 (ILLEGAL_DATA_VALUE).

For more information on PQ events, see Chapter 4 of the Device Manual.

Table 1-32 Register 6001 to 6004: Number of PQ Events

Register	Type of Information	Remark
6001 to 6002	PQ_Event_Number	Total number of PQ events
6003 to 6004	PQ_Event_Number	Number of PQ events since last polling

1.2.7 Modbus TCP Diagnosis

The diagnostics for Modbus TCP allows analyzing the parameters and communication as well as resetting the diagnostics counters. For more information, see the SENTRON PAC5100/5200 device manual, chapter 7.5.5 Configuration of the Device.

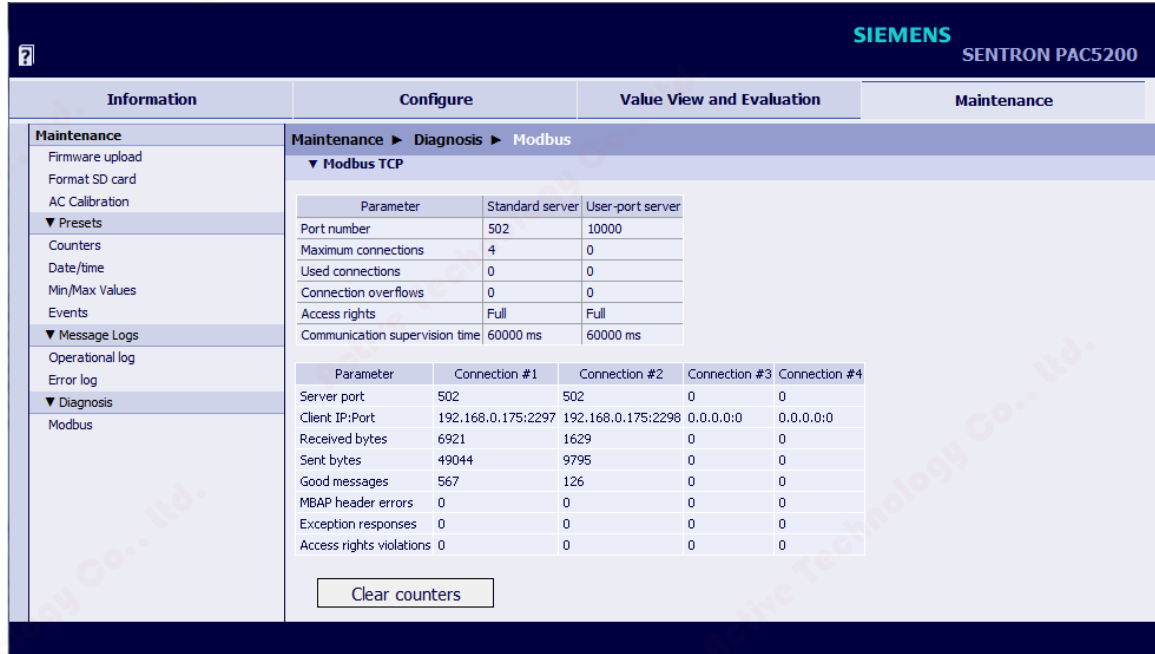


Figure 1-3 Modbus TCP Diagnosis

Parameter for Standard Server and User-port Server

- Port number: Standard port 502 and configured user port
- Maximum connections: For user port number 502: 4 connections via standard port 502
For other user port numbers: 2 connections via standard port 502 and 2 connections via the user port
- Used connections: Number of connections that are actually used
- Connection overflows: Counter of the attempts to establish more connections than allowed;
Number of allowed connection attempts:
For user port number 502: ≥ 5 connection attempts via standard port 502
For other user port numbers: ≥ 3 connection attempts via standard port 502 and/or ≥ 3 connection attempts via user port
- Access rights: Factory setting: Full
- Communication supervision time: Factory setting: 60 000 ms

Parameter of Connections

- Server port: Server port number of the current connection in the respective column; if **0** is displayed, the connection is inactive or down
- Client IP:Port: Last or current IP address and port number of the client
- Received bytes: Total number of bytes received by the TCP port
- Sent bytes: Total number of bytes sent to the TCP port
- Good messages: Total number of messages received that were detected as valid Modbus messages
- MBAP header errors: Error in the MBAP header: incorrect protocol ID or implausible length of data
- Exception responses: Counters of the transmitted exception response messages (see chapter 1.2.2)
- Access rights violations: Total number of write accesses received if the parameter **Access rights for port xxx** is set to **Read only** of the associated TCP port (for example 502) in the **Communication Ethernet** input/output window. For more information, see the device manual, chapter Operation - Ethernet Communication)

Glossary

A

AC	Alternating Current
ARP	Address Resolution Protocol: Network protocol

B

Big-Endian format	The most significant byte is stored first, that is at the memory location with the lowest address.
Broadcast message	Message in the network where data packets are transmitted to all devices on the network from one point

C

CRC error	Cyclic Redundancy Check: The cyclic redundancy check is a method of determining a test value for data (for example for data transmission in computer networks) with the purpose to detect errors during the transmission or duplication of data.
-----------	---

D

DC	Direct Current
DHCP	Dynamic Host Configuration Protocol enables the network configuration to be assigned to the devices by a DHCP server
DST	Daylight Saving Time

E

Ethernet	Cable-based data network technology for local data networks
----------	---

F

FW	Firmware: Program code for execution in a microcontroller
----	--

G

Gateway	Enables networks based on different protocols to communicate with each other
---------	--

H

Holding register	Area for representing data in Modbus communication
------------------	--

I	
ICD file	IED Capability Description: Contains the standardized description of the device configuration
IED	Intelligent Electronic Device
+Inf	Stands for <i>Infinity</i> and denotes a counter overflow. Extremely large number or infinitely positive number
IP	Internet Protocol
IP address	Addresses in computer networks based on the Internet protocol
K	
KeepAlive	<p>KeepAlive on TCP level is a feature intended to verify the availability and functioning of the communication partner (client) and to maintain a TCP network link if the network is inactive.</p> <p>The server sends KeepAlive messages (TCP packets without data) to the client in regular intervals (KeepAlive time) while the network is inactive, and the client responds to these messages.</p> <p>If the client does not respond to a KeepAlive message, the server assumes that the link is down or the client is inactive and closes the TCP link.</p>
L	
LED	Light-Emitting Diode
Limit violation	A value exceeding or falling under a parameterized limiting value.
LSB	Least Significant Bit
M	
MAC-Address	Media Access Control address: Hardware address that clearly identifies the device on the network.
MBAP	Modbus Application Protocol
MBAP Header	Header of a Modbus TCP message consisting of these 4 parts: Transaction identifier (2 bytes), protocol identifier (2 bytes), length (2 bytes), unit identifier (1 byte).
Modbus	The Modbus protocol is a communication protocol based on a client-server architecture.
Modbus TCP	Modbus Transmission Control Protocol: Modbus protocol type for transmitting data as TCP/IP packets; TCP port 502 is reserved for Modbus TCP.
MSB	Most Significant Bit
N	
NaN	Not a Number means "invalid": Result of an invalid computing operation
NTP	Network Time Protocol: Standard for synchronizing clocks in computer systems using packet-based communication networks

R

RJ45	Ethernet plug connector
RTC	Real-Time Clock

S

Server	Sends data upon request by the client
SNMP	Simple Network Management Protocol : Serves for monitoring and controlling network elements of a central station
SNTP	Simple Network Time Protocol : Simplified version of the NTP
SW	Software : Program executed on a computer
STP	Shielded twisted-pair is the cable for 100Base-T (Ethernet)
Subnet mask	Bit mask in the network protocol that defines how many IP addresses the computer network encompasses. Together with the IP address of a device, the subnet mask defines which IP addresses the device searches in its own network and which IP addresses it tries to reach via routers in other networks.

T

TCP/IP	Transmission Control Protocol/Internet Protocol : Family of network protocols
--------	--

Index

C

Communication features 14

D

Data in the Modbus registers 26
Data Type - Controllable Indications 24
Data Type - Counter 25
Data Type - Date/Time 23
Data Type - Indications 24
Data Type - Measured Value 22
Data Types 21
DHCP server 16

E

Ethernet Interface 17
Exception Responses 19

I

IP Address 14
IP-Addr. push-button 15

M

Modbus functions 18
Modbus TCP Diagnosis 92

N

Network configuration 16

R

Register assignment 21

T

TCP/IP Protocol Stack 14

